

ISA-d50.02
ISA/SP50-1992-236P

PARTIAL COPY, CHAPERS 11 & 13 OMITTED

* NOTE: ISA/SP50-1992-236P is a committee document number. When approved and published this draft will be designated ISA-S50.02, Part 2.



Instrument Society of America

67 Alexander Drive • P.O. Box 12277 • Research Triangle Park, NC 27709

Instrumentation • Systems • Automation
for the benefit of mankind

TO:	R. S. Crowder	Date:	24 June 1992
FAX #:	302 738 0855	Acct #:	2940
FM:	L. M. Ferson	Page #:	11 (including this page)
RE:	Committee Use of ISA/SP 50 --236P		

If message is received unclear or incomplete reply by FAX to number check below or call 919/549-8411.

ORIGINATING LOCATION:

ISA HEADQUARTERS

F 919/549-8288

RALEIGH FACILITY

F 919/832-0237

MESSAGE:

Bob,

This fax gives the IEEE 802.11 committee permission to copy ISA's SP50-236P draft for committee review purposes and to distribute copies of the document to the committee at their July 6-10, 1992 meeting. Please note this is a copyrighted ISA document. Since the public review cycle is complete, it is our intent to publish in the near future. If the IEEE committee wishes to cite this work, please have them contact us for the proper citation and standard designation.

Regards,

Lois Ferson,
Manager of Standards Services

cc. T. S. Lee
Q. S. Clark

ISA-dS50.02

ISA/SP50-1992-236P*

*PARTIAL COPY
CHAPS 11&13 OMITTED*

Draft Standard

Field Bus Standard for Use in Industrial Control Systems Part 2: Physical Layer Specification and Service Definitions

February 1992

"This document is a draft that represents work being done by an Instrument Society of America Standards Committee leading to the development of an ISA Standard. It is furnished for review purposes only.

The reader is cautioned that this document has not been approved and cannot be presumed to reflect the position of ISA or any other committee, society, or group. Although every effort has been made to ensure accuracy, neither the ISA, members of the S&P Department, or their employers shall be held liable for errors or limitations.

Participation of individuals in the development of this proposed standard shall not be construed as an unreserved endorsement of the proposed standard by the individuals or the employers of these individuals.

This draft may be reproduced in limited quantities for review purposes only."

*** Note:** ISA/SP50-1992-236P is a committee document number. When approved and published this draft will be designated ISA-S50.02, Part 2.



Instrument Society of America

CONTENTS

	Page
Foreword.....	vii
Clause	
0 Introduction	1
1 Scope.....	3
2 Normative references	3
3 Definitions	4
4 Symbols and abbreviations.....	5
5 Data Link – Physical Layer interface.....	7
6 Station Management – Physical Layer interface.....	10
7 DCE Independent Sublayer (DIS).....	12
8 DTE – DCE interface.....	12
9 Medium Dependent Sublayer (MDS): Wire media.....	25
10 MDS – MAU interface: Wire media	29
11 Medium Attachment Unit (MAU): 31,25 kbit/s, voltage mode, wire medium.....	31
12 Medium Attachment Unit (MAU): 1,0 Mbit/s, voltage mode, wire medium.....	46
13 Medium Attachment Unit (MAU): Current mode, wire medium	60
14 Medium Attachment Unit (MAU): 2,5 Mbit/s, voltage mode, wire medium.....	73
15 Medium Dependent Sublayer (MDS): Optical (Under consideration).	86
16 MDS – MAU Interface: Optical (Under consideration).	86
17 Medium Attachment Unit (MAU): Optical (Under consideration).	86
18 Medium Dependent Sublayer (MDS): Radio (Under consideration).	86
19 MDS – MAU Interface: Radio (Under consideration).	86
20 Medium Attachment Unit (MAU): Radio (Under consideration).	86
Annex	
A Bibliography and References (Informative)	87

B	IEC Field Bus connector specification (Normative).....	88
C	Cable Specifications and Trunk and Spur Lengths for the 31.25 kbit/s Voltage-mode MAU (Informative)	97

TABLE LIST

Table		Page
1	Parameter names and values for Ph-SETVALUE request.....	11
2	Parameter names for Ph-EVENT indication.....	12
3	Signals at DTE - DCE interface.....	15
4	Signal levels for an exposed DTE - DCE interface	15
5	Encoding rules	26
6	Minimum service at MDS - MAU interface.....	29
7	Signal levels for an exposed MDS - MAU interface	30
8	Transmit level specification summary for 31,25 kbit/s, voltage-mode MAU.....	34
9	Transmit timing specification summary for 31,25 kbit/s, voltage-mode MAU.....	34
10	Receive circuit specification summary for 31,25 kbit/s, voltage-mode MAU.....	37
11	Network powered device characteristics for the 31,25 kbit/s voltage-mode MAU.....	40
12	Network power supply requirements for the 31,25 kbit/s voltage-mode MAU	40
13	Transmit level specification summary for 1,0 Mbit/s, voltage-mode MAU	49
14	Transmit timing specification summary for 1,0 Mbit/s, voltage-mode MAU	50
15	Receive circuit specification summary for 1,0 Mbit/s, voltage-mode MAU	53
16	Network powered device characteristics for the 1,0 Mbit/s voltage-mode MAU	55
17	Network power supply requirements for the 1,0 Mbit/s voltage-mode MAU	56
18	Transmit level specification summary for current-mode MAU	63
19	Transmit timing specification summary for current-mode MAU	64
20	Receive circuit specification summary for current-mode MAU.....	66
21	Network power supply requirements for the current-mode MAU.....	70

22	Transmit level specification summary for 2,5 Mbit/s, voltage-mode MAU.....	76
23	Transmit timing specification summary for 2,5 Mbit/s, voltage-mode MAU	76
24	Receive circuit specification summary for 2,5 Mbit/s, voltage-mode MAU.....	79
25	Network powered device characteristics for the 2,5 Mbit/s voltage-mode MAU	81
26	Network power supply requirements for the 2,5 Mbit/s voltage-mode MAU	82
B.1	Internal connector dimensions	89
B.2	Contact assignments for the external connector for harsh environments	90
B.3	Contact assignments for the external connector for typical environments	94
B.4	Fixed (device) side connector dimensions.....	95
B.5	Free (cable) side connector dimensions.....	96
C.1	Typical cable specifications.....	97
C.2	Recommended maximum spur lengths vs. number of elements.....	98

FIGURE LIST

Figure		Page
1	General Model of Physical Layer	2
2	Mapping between data units across the DL - Ph interface	7
3	DTE/DCE sequencing machines	18
4	Protocol Data Unit (PhPDU)	25
5	PhSDU encoding and decoding	26
6	Encoding rules.....	26
7	Preamble and delimiters	28
8	Transmit circuit test configuration	34
9	Output waveform	35
10	Transmitted bit cell jitter (zero crossing point deviation)	36
11	Receiver sensitivity and noise rejection.....	38
12	Received bit cell jitter.....	39

13	Power supply ripple and noise	42
14	Field Bus coupling device	44
15	Protection resistors.....	44
16	Transmit circuit test configuration	50
17	Output waveform.....	51
18	Transmitted bit cell jitter (zero crossing point deviation)	52
19	Receiver sensitivity and noise rejection.....	53
20	Received bit cell jitter.....	55
21	Power supply ripple and noise	57
22	Field Bus coupling device	59
23	Protection resistors.....	59
24	Test configuration for current-mode MAU	64
25	Output waveform.....	64
26	Transmitted bit cell jitter (zero crossing point deviation)	66
27	Noise rejection and signal level thresholds.....	67
28	Noise test circuit for current-mode MAU	68
29	Received bit cell jitter.....	69
30	Transmit circuit test configuration	76
31	Output waveform.....	77
32	Transmitted bit cell jitter (zero crossing point deviation)	78
33	Receiver sensitivity and noise rejection.....	79
34	Received bit cell jitter.....	81
35	Power supply ripple and noise	83
36	Field Bus coupling device	85
B.1	Internal Field Bus connector	88
B.2	Contact designations for the external connector for harsh environments.....	90
B.3	External Field Bus connector keyways, keys, and bayonet pins and grooves.....	91

B.4 External Field Bus connector intermateability dimensions	92
B.5 External Field Bus connector contact arrangement	93
B.6 Contact designations for the external connector for typical environments	95
B.7 External fixed (device) side connector for typical industrial environments: dimensions .	95
B.8 External free (cable) side connector for typical industrial environments: dimensions.....	96

ISA DRAFT

THIS SPACE INTENTIONALLY LEFT BLANK FOR TITLE AND FOREWORD

ISA DRAFT

This document is Part 2 of a set of eight which together provide a complete Field Bus standard. The other parts are as follows:

Part 1 : Introductory Guide

Part 3 : Data Link Service Definition

Part 4 : Data Link Protocol Specification

Part 5 : Application Service Definition

Part 6 : Application Protocol Specification

Part 7 : Field Bus Management

Part 8 : Conformance Testing

THIS SPACE INTENTIONALLY LEFT BLANK

ISA DRAFT

ISA DRAFT

0 Introduction

A Field Bus is a digital, serial, multidrop, data bus for communication with low level industrial control and instrumentation devices such as transducers, actuators and local controllers. The Physical Layer specified in this part of this International Standard provides for transparent transmission of data units between Data Link Layer entities across physical connections.

The Physical Layer receives data units from the Data Link Layer, adds preamble and delimiters, provides encoding and transmits the resulting physical signals to the transmission medium at one node. Signals are then received at one or more other nodes, decoded and stripped of preamble and delimiters, before being passed to the Data Link Layer of the receiving device.

Currently this part of this International Standard only specifies wire media. The common characteristics for wire media are as follows:

- a) digital data transmission;
- b) self-clocking;
- c) half-duplex communication (bidirectional but in only one direction at a time);
- d) Manchester coding.

The major variations for these media are two modes of coupling and three signaling speeds as follows:

- 1) voltage mode (parallel coupling), 31,25 kbit/s;
- 2) voltage mode (parallel coupling), 1,0 Mbit/s;
- 3) current mode (serial coupling), 1,0 Mbit/s;
- 4) voltage mode (parallel coupling), 2,5 Mbit/s.

The voltage mode variations 1), 2), and 4) may be implemented with inductive coupling using transformers. This is not mandatory if the isolation requirements of this part of this International Standard are met by other means.

Alternative media (e.g. coaxial cable, optical fibre and radio transmission) and speeds are not included in this edition of this part of this International Standard.

The Physical Layer provides the options:

- i) no power via the bus conductors; not intrinsically safe;
- ii) power via the bus conductors; not intrinsically safe;
- iii) no power via the bus conductors; intrinsically safe;
- iv) power via the bus conductors; intrinsically safe.

A Field Bus communication element is considered to be implemented in two parts, the Data Terminal Equipment (DTE) and the Data Communication Equipment (DCE). The DTE includes only one part

of the Physical Layer, the DCE Independent Sublayer (DIS). The DIS transfers Interface Data Units (octets) across a Data Link Layer - Physical Layer interface which is not exposed to the user. The DIS then passes the Interface Data as a serial stream of binary Physical Layer Service Data Units (bits) across the DTE - DCE interface, which may optionally be exposed to the user, to a Medium Dependent Sublayer (MDS).

Three alternative types of MDS are currently envisaged; one for wire media, one for optical media, and one for radio. The MDS adds preamble plus start delimiter before the data block, adds an end delimiter after the data block and encodes the data. In the reverse direction it decodes signals received via the medium, removing preamble and delimiters and providing signal quality error checking.

Serial encoded signals are passed across an interface, which may optionally be exposed, to a Medium Attachment Unit (MAU) which transmits and receives Physical Layer signals via the medium. A general model of the Physical Layer is shown in figure 1.

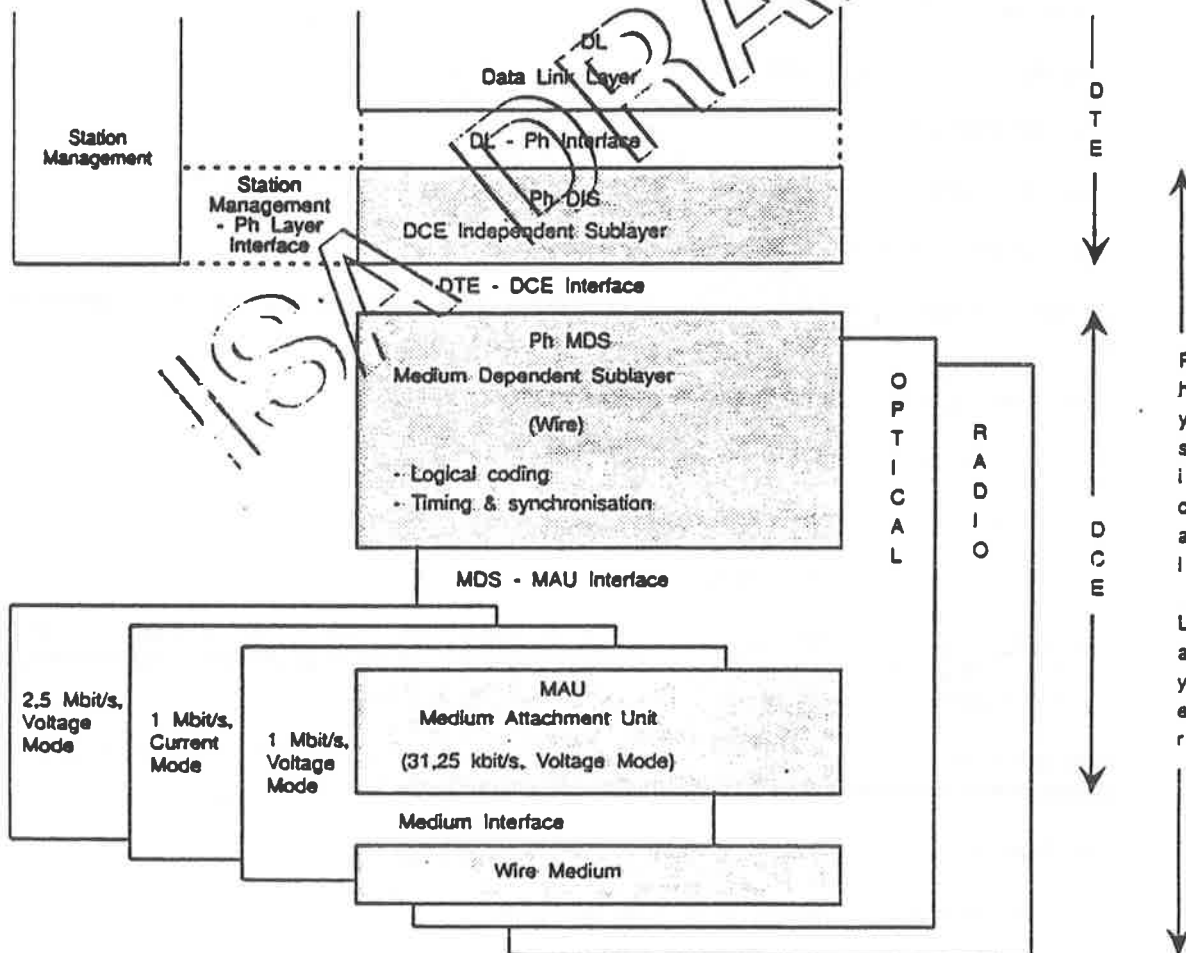


Figure 1 — General model of Physical Layer

1 Scope

This part of this standard specifies the requirements for Field Bus component parts. It also specifies the media and network configuration requirements necessary to ensure agreed levels of:

- a) data integrity before Data Link Layer error checking;
- b) interoperability between devices at the Physical Layer.

The Field Bus Physical Layer conforms to layer 1 of the OSI 7-layer model as defined by ISO 7498 with the exception that frame delimiters are in the Physical Layer.

This part of this standard should be read in conjunction with Part 1, Introductory Guide, Part 3, Data Link Layer and Part 7, Field Bus Management. The conformance testing requirements will be contained in Part 8 of this International Standard.

2 Normative references

The following standards contain provisions which, through reference in this text, constitute provisions of this part of this International Standard. At the time of publication, the editions indicated were valid. All standards are subject to revision and parties to agreements based on this part of this International Standard are encouraged to investigate the possibility of applying the most recent editions of the standards listed below. Members of JEC and ISO maintain registers of currently valid International Standards.

65C (Secretariat) *Field Bus standard Parts 1, and 3 through 8 (under consideration).*

65A (Central Office) 22 *Programmable controllers - Part 2: Equipment characteristics.*

IEC 255-4 (1976) *Single input energizing quantity measuring relays with dependent specified time.*

IEC 529 (1989) *Classification of degrees of protection provided by enclosures.*

IEC 760 (1989) *Flat, quick-connect terminations*

IEC 801 *Electromagnetic compatibility for industrial-process measurement and control equipment.*

IEC 801.1 (1984) *Part 1: General introduction.*

IEC 801.2 (1984) *Part 2: Electrostatic discharge requirements.*

IEC 801.3 (1984) *Part 3: Radiated electromagnetic field requirements.*

IEC 801.4 (1988) *Part 4: Electrical fast transient/burst requirements.*

IEC 807-3 (1990) *Rectangular Connectors for frequencies below 3 MHz.*

ISO 7498 (1984) *Information Processing Systems - Open Systems Interconnection - Basic Reference Model*

NOTE — A list of standards referred to for information only in this part of this International Standard is given in Annex A.

3 Definitions

For the purpose of this part of this International Standard, the following definitions apply together with those in ISO 7498.

3.1 activity: The presence of a signal or noise at the input terminals of a Field Bus device which is of a level which is above the receiver signal level threshold of that device.

3.2 barrier: Physical entity which limits current and voltage into a hazardous area in order to satisfy Intrinsic Safety requirements.

3.3 bus: The trunk and all devices connected to it.

3.4 communication element: Part of a Field Bus device which communicates with other elements via the bus.

3.5 connector: Coupling device employed to connect the medium of one circuit or communication element with that of another circuit or communication element.

NOTE — This definition is taken from IEEE Std 100-1984, modified for this standard.

3.6 coupler: Physical interface between trunk and spur or trunk and device.

3.7 Data Communications Equipment (DCE): the embodiment of the media, modulation and coding-dependent portion of a Field Bus-connected device, comprising the lower portions of the Physical layer within the device.

3.8 Data Terminal Equipment (DTE): the embodiment of the media, modulation and coding-independent portion of a Field Bus-connected device, comprising the upper-most portion of the Physical layer and all higher layers within the device.

3.9 delimiter: Flag that separates and organizes items of data.

NOTE — This definition is taken from IEEE Std 100-1984.

3.10 device: Physical entity connected to the Field Bus composed of at least one communication element (the network element) and which may have a control element and/or a final element (transducer, actuator, etc.).

3.11 frame: A set of consecutive digit time slots in which the position of each digit time slot can be identified by reference to a framing signal.

NOTE — This definition is taken from IEEE Std 100-1984.

3.12 intrinsic safety: Design methodology for a circuit or an assembly of circuits in which any spark or thermal effect produced under normal operating and specified fault conditions is not capable under prescribed test conditions of causing ignition of a given explosive atmosphere.

NOTE — This definition is taken from EN 50 020 :1977 (Intrinsically-safe electrical apparatus).

3.13 isolation: Physical and electrical arrangement of the parts of a signal transmission system to prevent electrical interference currents within or between the parts.

NOTE — This definition is taken from IEEE Std 100-1984.

3.14 jabber: Continuous transmission on the medium due to a faulty device.

3.15 Manchester encoding: Means by which separate data and clock signals can be combined into a single, self-synchronizing data stream, suitable for transmission on a serial channel.

3.16 medium: Cable, optical fibre, or other means by which communication signals are transmitted between two or more points.

NOTE — In this part of this International Standard "media" is used only as the plural of medium.

3.17 network: All of the media, connectors, and associated communication elements by which a given set of communicating devices are interconnected.

3.18 node: End-point of a branch in a network or a point at which one or more branches meet.

NOTE — This definition is taken from the IEC Multilingual Dictionary.

3.19 repeater: Device used to extend the range over which signals can be correctly transmitted and received for a given medium.

3.20 segment: The section of a Field Bus which is terminated in its characteristic impedance. Segments are linked by repeaters to form a complete Field Bus.

3.21 separately powered device: Device that does not receive its operating power via the Field Bus signal conductors.

3.22 shield: Surrounding earthed metallic layer to confine the electric field within the cable and to protect the cable from external electrical influence.

NOTE — Metallic sheaths, armours and earthed concentric conductors may also serve as a shield.

3.23 spur: Branch-line (i.e. a link connected to a larger one at a point on its route) which is a final circuit.

NOTE — This definition is taken from IEEE Std 100-1984.

3.24 transceiver: Combination of receiving and transmitting equipment in a common housing employing common circuit components for both transmitting and receiving.

NOTE — This definition is taken from IEEE Std 100-1984 (modified for non-radio use).

3.25 transmitter: Transmit circuitry of a communication element.

3.26 trunk: Main communication highway acting as a source of main supply to a number of other lines (spurs).

NOTE — This definition is taken from IEEE Std 100-1984 (modified).

4 Symbols and abbreviations

4.1 Symbols

For the purpose of this part of this International Standard, the following symbols apply:

Symbol	Definition	Units
f_r	Frequency corresponding to the bit rate	Hertz (Hz)
N+	Non-data symbol - positive	none
N-	Non-data symbol - negative	none
P	Nominal period of octet transmission	seconds
V _{DD}	The most positive supply level	Volts (V)
V _{IH}	Minimum high-level input voltage	Volts (V)
V _{IL}	Maximum low-level input voltage	Volts (V)
V _{OH}	Minimum high-level output voltage	Volts (V)
V _{OL}	Maximum low-level output voltage	Volts (V)
Z	Impedance	Ohms (Ω)
Z ₀	Characteristic impedance (of cable)	Ohms (Ω)

4.2 Abbreviations

The following abbreviations are used in this part of this International Standard:

CTS	Clear To Send signal (from DCE)
DCE	Data Communication Equipment
DIS	DCE Independent Sublayer
DL	Data Link — Approximately Layer 2 of the OSI model (ISO 7498)
DLE	Data Link Entity
DLL	Data Link Layer — Defined in ISO 7498
DTE	Data Terminal Equipment
EMI	Electro-Magnetic Interference
IDU	Interface Data Unit — Defined in ISO 7498
I.S.	Intrinsic Safety — Certification method for use of electrical equipment in flammable atmospheres
kbit/s	thousand bits per second
LbE	Loopback Enable signal (to MAU)
MAU	Medium Attachment Unit — For wire media, MAU = transceiver
Mbit/s	Million bits per second
MDS	Medium Dependent Sublayer
NRZ	Non-return-to-zero code — High level = logic 1, Low level = logic 0
Ph	Physical — Approximately Layer 1 of the OSI model (ISO 7498)
PhE	Physical layer Entity — Defined in ISO 7498
PhL	Physical Layer — Defined in ISO 7498
PhICI	Physical layer Interface Control Information — Defined in ISO 7498
PhID	Physical layer Interface Data — Defined in ISO 7498
PhIDU	Physical layer Interface Data Unit — Defined in ISO 7498
PhPCI	Physical layer Protocol Control Information — Defined in ISO 7498
PhPDU	Physical layer Protocol Data Unit — Defined in ISO 7498
PhS	Physical layer Service — Defined in ISO 7498
PhSAP	Physical layer Service Access Point — Defined in ISO 7498
PhSDU	Physical layer Service Data Unit — Defined in ISO 7498
pk	Peak
pk-pk	Peak-to-peak
RDF	Receive Data and Framing signal (from DCE)
RFI	Radio Frequency Interference
RTS	Request To Send signal (to DCE)
RxA	Receive Activity signal (from DCE)
RxC	Receive Clock signal (from DCE)
RxS	Receive Signal (from MAU)
TxC	Transmit Clock signal (from DCE)

TxD	Transmit Data signal (to DCE)
TxE	Transmit Enable signal (to MAU)
TxS	Transmit Signal (to MAU)
SDU	Service Data Unit — Defined in ISO 7498

5 Data Link – Physical Layer interface

This clause defines the required Physical Service (PhS) primitives and constraints on their use.

NOTES

- 1 The requirements for a Field Bus Data Link Layer are specified in Part 4 of this International Standard. Services at the interface between the Data Link Layer and Physical Layer are specified in 5.1 and 5.2.
- 2 The Data Link – Physical interface is a virtual service interface between virtual machines; there are no requirements for physical signal lines as the standard does not require this interface to be exposed.

5.1 Required services

PhIDUs shall be transferred between the Data Link Layer and the Physical Layer in accordance with the requirements of ISO 7498 as shown in figure 2.

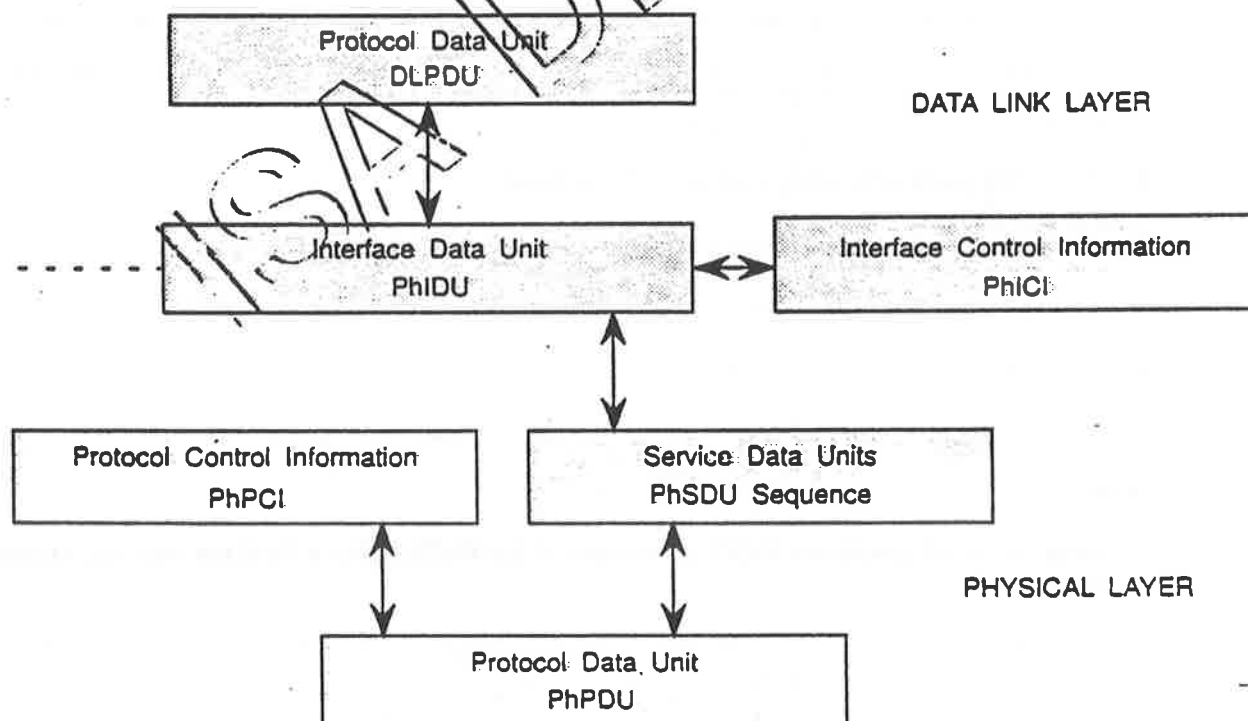


Figure 2 — Mapping between data units across the DL – Ph interface

NOTES

- 1 These services provide for the interchange of PhIDUs between a Data Link Layer entity and its associated Physical Layer entity. Such a transfer is part of a transaction between cooperating Data Link Layer entities. The services listed in this section are the minimum which can jointly provide the means by which cooperating Data Link Layer entities can coordinate their transmission and their exchange of data on the shared communication medium.
- 2 Proper layering requires that an (N+1)-layer entity not be concerned with, and that an (N)-service interface not overly constrain, the means by which an (N)-layer provides its (N)-services. Thus the Ph-service interface does not require DLEs

to be aware of internal details of the PhE (e.g., preamble, postamble and frame delimiter signal patterns, number of bits per baud), and should not prevent the PhE from using appropriate evolving technologies.

5.1.1 Primitives of the PhS

The granularity of PhS-user data exchanged at the PhL - DLL interface is one octet.

5.1.1.1 Ph-Characteristics Indication

The PhS shall provide the following service primitive to report essential PhS characteristics (which may be used in DLL transmission, reception, and scheduling activities):

...Ph-CHARACTERISTICS indication (minimum-data-rate, framing-overhead)

where

minimum-data-rate — shall specify the effective minimum rate of data conveyance in bits/second, including any timing tolerances.

NOTE — A PhE with a nominal data rate of 1 Mbit/s \pm 0.01% would specify a minimum data rate of 0.9999 Mbit/s.

framing-overhead — shall specify the maximum number of bit periods (where period is the inverse of the data rate) used in any transmission for PhPDUs which do not directly convey data (e.g., PhPDUs conveying preamble, frame delimiters, postamble, inter-frame "silence", etc.).

NOTE — If the framing overhead is F and two DL message lengths are L_1 and L_2 , then the time to send one message of length $L_1 + F + L_2$ will be at least as great as the time required to send two immediately consecutive messages of lengths L_1 and L_2 .

5.1.1.2 PhS transmission and reception services

The PhS shall provide the following service primitives for transmission and reception:

Ph-DATA request (class, data)

Ph-DATA indication (class, data)

Ph-DATA confirm (status)

where

class — shall specify the PhICI component of the PhIDU. For a Ph-DATA request, its possible values shall be:

START-OF-ACTIVITY — transmission of the PhPDUs which precede Ph-user data shall commence;

DATA — the single-octet value of the associated data parameter shall be transmitted as part of a continuous correctly-formed transmission; and

END-OF-DATA-AND-ACTIVITY — the PhPDUs which terminate Ph-user data shall be transmitted after the last preceding octet of Ph-user data, culminating in the cessation of active transmission.

For a Ph-DATA indication, its possible values shall be:

START-OF-ACTIVITY — reception of an apparent transmission from one or more PhEs has commenced;

DATA — the associated data parameter was received as part of a continuous correctly-formed reception;

END-OF-DATA — the ongoing continuous correctly-formed reception of Ph-user data has concluded with correct reception of PhPDUs implying END-OF-DATA;

END-OF-ACTIVITY — the ongoing reception (of an apparent transmission from one or more PhEs) has concluded, with no further evidence of PhE transmission; and

END-OF-DATA-AND-ACTIVITY — simultaneous occurrence of END-OF-DATA and END-OF-ACTIVITY.

data — shall specify the PhID component of the PhIDU. It consists of one octet of Ph-user-data to be transmitted (Ph-DATA request) or which was received successfully (Ph-DATA indication).

status — shall specify either success or the locally-detected reason for inferring failure.

The Ph-DATA confirm primitive shall provide the critical physical timing feedback necessary to inhibit the DLE from starting a second transmission before the first is complete. The final Ph-DATA confirm of a transmission shall not be issued until the PhE has completed the transmission.

5.1.2 Notification of PhS characteristics

The PhE has the responsibility for notifying the DLE of those characteristics of the PhS which may be relevant to DLE operation. The PhE shall do this by issuing a single Ph-CHARACTERISTICS indication primitive at each of the PhE's PhSAPs at PhE startup.

5.1.3 Transmission of Ph-user-data

The PhE shall determine the timing of all transmissions. When a DLE transmits a sequence of PhSDUs, the DLE shall send the sequence of PhSDUs by making a well-formed sequence of Ph-DATA requests, consisting of a single request specifying START-OF-ACTIVITY, followed by 3 to 300 consecutive requests, inclusive, specifying DATA, each conveying a PhSDU, and concluded by a single request specifying END-OF-DATA-AND-ACTIVITY.

The PhE shall signal its completion of each Ph-DATA request, and its readiness to accept a new Ph-DATA request, by issuing a Ph-DATA confirm primitive; the status parameter of the Ph-DATA confirm primitive shall convey the success or failure of the associated Ph-DATA request. A second Ph-DATA request shall not be issued by the DLE until after the Ph-DATA confirm corresponding to the first request has been issued by the PhE.

5.1.4 Reception of Ph-user-data

The PhE shall report a received transmission with a well-formed sequence of Ph-DATA indications, which shall consist of either

- a) a single indication specifying START-OF-ACTIVITY; followed by consecutive indications specifying DATA, each conveying a PhSDU; followed by a single indication specifying END-OF-DATA; and concluded by a single indication specifying END-OF-ACTIVITY; or
- b) a single indication specifying START-OF-ACTIVITY; followed by consecutive indications specifying DATA, each conveying a PhSDU; followed by a single indication specifying END-OF-DATA-AND-ACTIVITY; or

c) a single indication specifying START-OF-ACTIVITY; optionally followed by one or more consecutive indications specifying DATA, each conveying a PhSDU; and concluded by a single indication specifying END-OF-ACTIVITY.

This last sequence is indicative of an incomplete or incorrect reception. Detection of an error in the sequence of received PhPDUs, or in the PhE's reception process, shall disable further Ph-DATA indications with a class parameter specifying DATA, END-OF-DATA, or END-OF-DATA-AND-ACTIVITY until after both the end of the current period of activity and the start of a subsequent period of activity have been reported by Ph-DATA indications specifying END-OF-ACTIVITY and START-OF-ACTIVITY, respectively.

6 Station Management - Physical Layer interface

NOTES

- 1 This interface provides services to the Physical Layer which are required for initialization and selection of options.
- 2 One of the objectives of the Physical Layer is to allow for future variations such as radio, fibre optics, redundant channels (e.g. cables), different modulation techniques etc. A general form of Station Management - Physical Layer Interface is specified which provides the services required by implementations of these variations. Services provided by this interface are specified in 6.1 and 6.2. The standard does not require this interface to be exposed.
- 3 The complete set of management services can only be used when the device is directly coupled to the medium. In the case of actively coupled equipment (e.g. active coupler, repeater, radio/telephone modem, opto-electronics etc.) some of the services can be implicit to the active coupler. Moreover, each device can use a subset of the described primitives.

6.1 Required services

The minimum service primitive for Physical Layer (PhL) management shall be:

- a) Ph-RESET request — reset of the Ph-Layer.

The following additional services may be provided:

- b) Ph-SETVALUE request / Ph-SETVALUE confirm — set parameters;
- c) Ph-GETVALUE request / Ph-GETVALUE confirm — read parameters;
- d) Ph-EVENT indication — report Ph-Layer events.

6.2 Service primitive requirements

6.2.1 Ph-RESET request

This primitive has no parameter. Upon reception of this primitive the Physical Layer shall reset all its functions.

6.2.2 Ph-SETVALUE request (parameter name, new value)

If this primitive is used it shall allow Station Management to modify the parameters of the Physical Layer. Standard parameter names and value ranges are given in table 1. The value assumed for each parameter at reset shall be the first of those shown for the parameter.

Table 1 — Parameter names and values for Ph-SETVALUE request

Parameter name	Range of values
Interface mode	<ul style="list-style-type: none"> • FULL_DUPLEX • HALF_DUPLEX
Loop-back mode	<ul style="list-style-type: none"> • DISABLED • in MDS at DTE-DCE interface • in MAU near line connection
Preamble extension	• 0..7 (preamble extension sequences)
Post-transmission gap extension	• 0..7 (gap extension sequences)
Maximum inter-channel signal skew	• 0..7 (gap extension sequences)
Transmitter output channel N ($1 \leq N \leq 8$)	<ul style="list-style-type: none"> • ENABLED • DISABLED
Receiver input channel N ($1 \leq N \leq 8$)	<ul style="list-style-type: none"> • ENABLED • DISABLED
Preferred receive channel	<ul style="list-style-type: none"> • NONE • 1..8

NOTES

- 1 Not all implementations require every parameter, and some may need more.
- 2 Each DCE standard specifies both the basic and extension sequences of PhPDUs to be sent as preamble. These extension sequences are always prefixed to the basic sequence.
- 3 Each DCE standard specifies the lengths of both the basic and extension sequences of post-transmission gap during which the transmitter should be silent.
- 4 From the above, the default value at reset is minimum preamble (no extension), minimum post-transmission gap (no extension), full-duplex interface mode, not in loopback, with all transmit and receive channels enabled, and with no preferred receive channel.

6.2.3 Ph-SETVALUE confirm (status)

This primitive has a single parameter indicating the status of the request: Success or Failure. If this primitive is used it shall acknowledge completion of the Ph-SETVALUE request in the Physical Layer.

6.2.4 Ph-GETVALUE request (parameter name)

If this primitive is used it shall allow the Station Management to read the parameters of the Physical Layer. The parameter shall have one of the names given in table 1.

6.2.5 Ph-GETVALUE confirm (current value)

This primitive is the response of the Physical Layer to the Ph-GETVALUE request. If this primitive is used it shall have a single parameter reporting either the failure of the request — Failure — or the present value of the requested parameter. The current value shall be one of those permitted by 6.2.2.

6.2.6 Ph-EVENT indication (parameter name)

If this primitive is used it shall notify the Station Management of a Physical Layer parameter modification which has not been requested by the Station Management. The parameter shall have one of the names and values given in table 2, based on names specified in clause 8.

NOTE — Additions to table 2 are possible if required by specific implementations.

Table 2 — Parameter names for Ph-EVENT indication

Parameter name
DTE fault
DCE fault

7 DCE Independent Sublayer (DIS)

NOTES

1 The Physical Layer entity is partitioned into a Data Terminal Equipment (DTE) component and a Data Communication Equipment (DCE) component. The DTE component interfaces with the Data Link Layer entity, and forms the DCE Independent Sublayer (DIS). It exchanges Interface Data Units across the DL - Ph interface defined in clause 5, and provides the basic conversions between the PhIDU "at-a-time" viewpoint of the DL - Ph interface and the bit serial viewpoint required for physical transmission and reception.

2 This sublayer is independent of all the Physical Layer variations, including encoding and/or modulation, speed, voltage/current/optical mode, medium etc. All these variations are grouped under the designation Data Communication Equipment (DCE).

The DIS shall sequence the transmission of the PhID as a sequence of serial PhSDUs. Similarly, the DIS shall form the PhID to be reported to the Data Link Layer from the sequence of received serial PhSDUs.

The PhID shall be converted to a sequence of PhSDUs for serial transmission in octets up to a maximum of 300 octets. A PhSDU representing more significant octets of the PhID shall be sent before or at the same time as a PhSDU representing less-significant octets and such that within each octet, a PhSDU representing a more-significant bit will be transmitted before or at the same time as a PhSDU representing a less-significant bit. On reception, each sequence of PhSDUs shall be converted to PhID such that, in the absence of errors, the PhIDU indicated to the receiving Data Link Layer entity shall be unchanged from the PhIDU whose transmission was requested by the originating Data Link Layer entity.

NOTE 3 — This is a guarantee of transparency.

8 DTE - DCE interface

NOTES

1 The Physical Layer entity is partitioned into a Data Terminal Equipment (DTE) component containing the MIS and higher layers, and a Data Communication Equipment (DCE) component containing the MOS and lower sub-layers. The DTE - DCE interface connects these two physical components.

2 It is not mandatory for the DTE - DCE interface, or any other interface, to be exposed.

3 The DTE - DCE interface is a functional and electrical, but not mechanical, interface which supports a set of services. Each of these services is implemented by a sequence of defined signaling interactions at the interface.

8.1 Services

The following services, defined in this sub-clause, shall be supported by the DTE - DCE interface:

- a) DTE to DCE reset service;
- b) DTE to DCE configuration service;
- c) DTE to DCE message transmission service;
- d) DCE to DTE fault notification service;
- e) DCE to DTE media-activity indication service;
- f) DCE to DTE message reporting service

8.1.1 DTE to DCE reset service

This service shall provide a means by which the DTE, at any time, can reset the DCE to its initial (power-on) state.

8.1.2 DTE to DCE configuration service

This service shall provide a means by which the DTE can configure various characteristics of the DCE, including those characteristics which station management can adjust via Ph-SETVALUE requests (see table 1). It also shall provide a DCE-optional means by which the DTE can initiate reporting of DCE status by preemptive use of the DCE to DTE message reporting service.

8.1.3 DTE to DCE message transmission service

This service shall provide a means by which the DTE can transmit a message through the DCE to either the connected medium (media), or back to the DTE, or both, as determined by the current operational values of the parameters specified in table 1. The DCE shall provide the pacing for this service.

This service is invoked upon receipt of the beginning of a well-formed sequence of Ph-DATA requests at the PhL service interface, and runs concurrently with that sequence of received Ph-DATA requests.

8.1.4 DCE to DTE fault notification service

This service shall provide a means by which the DCE, at any time, can report a fault. The specific nature of the fault is not reported by this service, but may be determinable by use of the DTE to DCE configuration service to initiate a DCE-optional DCE status report.

8.1.5 DCE to DTE media-activity indication service

This service shall provide a means by which the DCE reports the inferred detection, on any of its connected media for which receiving is enabled (see table 1), of signaling from itself or other Ph-layer entities. While loopback is enabled, this service reports only the signaling of the DCE itself.

When the DTE - DCE interface is in half-duplex mode and loopback is not enabled, this service need not report media activity resulting directly from the DTE to DCE message transmission service.

8.1.6 DCE to DTE message reporting service

This service shall provide a means by which the DCE reports the receipt of a sequence of PhPDUs from any one of the connected media for which receiving is enabled. This service terminates with an indication of whether the sequence of received PhPDUs was well-formed. Errors in the sequence, including number of PhPDUs such that they could not have been a correct transmission resulting from an invocation of the DCE to DTE message transmission service shall be reported as a malformed (erroneous) sequence.

NOTE — Errors in the octet alignment of a received end delimiter with respect to the preceding start delimiter (i.e., not separated by an integral number of octets of data bits) is to be reported as a malformed sequence.

When the DTE - DCE interface is in half-duplex mode and loopback is not enabled, this service need not report the message transmitted by the DCE to DTE message transmission service.

8.2 Interface signals

If the DTE - DCE interface is exposed it shall provide the signals specified in table 3.

Table 3 — Signals at DTE - DCE Interface

Signal	Abbreviation	Source
Transmit Clock	TxC	DCE
Request to Send	RTS	DTE
Clear to Send	CTS	DCE
Transmit Data	TxD	DTE
Receive Clock	RxC	DCE
Receive Activity	RxA	DCE
Receive Data and Framing	RDF	DCE

The signal levels shall be as shown in table 4. In general, both sides of the interface shall operate with the same approximate value of V_{00} . However, it is recognized that a DTE and a DCE with separate power supplies may not both reach operational V_{00} simultaneously. It is desirable, but not mandatory, that the DTE to DCE reset service be operational when the DCE has not yet reached operational V_{00} . It is also desirable that the DTE invoke this service whenever its own V_{00} is below operational margins.

Table 4 — Signal levels for an exposed DTE – DCE interface

Symbol	Parameter	Conditions	Limits	Units	Remarks
V_{OL}	Maximum low-level output voltage	$I_{out} = \pm 100 \mu A$	0,1	V	See Note 1
		$I_{out} = +1,6 \text{ mA}$	0,4	V	
V_{OH}	Minimum high-level output voltage	$I_{out} = \pm 100 \mu A$	$V_{DD} - 0,1$	V	See Note 1
		$I_{out} = -0,8 \text{ mA}$	$V_{DD} - 0,8$	V	See Note 2
V_{IL}	Maximum low-level input voltage		$0,2 V_{DD}$	V	
V_{IH}	Minimum high-level input voltage		$0,7 V_{DD}$	V	See Note 3
NOTES 1 Provides the capability to drive two typical CMOS loads. 2 CMOS input compatibility with TTL output requires a "pull-up" resistor from signal input to V_{DD} . 3 Compatible with CMOS output for $3,0 \text{ V} \leq V_{DD} \leq 5,5 \text{ V}$. Compatibility with TTL output ($4,75 \text{ V} \leq V_{DD} \leq 5,25 \text{ V}$) requires a "pull-up" resistor from signal input to V_{DD} .					

The timing characteristics of these signals shall be at least equal to those specified for the relevant DCE in the requirements of this part of this International Standard. However, in no case shall the transition time between $0,2 V_{DD}$ and $0,6 V_{DD}$ be greater than either 100 ns or $0,025 P$, whichever is smaller. P is defined as the nominal period of octet transmission — the inverse of the nominal PhSDU rate.

An implementation of the DTE – DCE interface shall function correctly with transmit and receive (TxC and RxC) clock frequencies between 1 kHz and 8,8 times the highest supported PhSDU rate of the DTE or DCE implementation.

NOTE — The PhSDU and equivalent bit data rates available in an implementation are stated in the Protocol Implementation Conformance Statement (PICS).

8.2.1 Transmit Clock (TxC)

The Transmit Clock signal (TxC) shall provide the DTE with a continuous timing signal, such that any eight consecutive full cycles of this signal shall have the same octet period as the nominal transmit period for one data octet. The DCE shall source this nominally two-phase signal such that each phase has a duration of at least $0,04 P$.

NOTE — This specification permits TxC to be a continuous, constant-period clock at the nominal bit rate (8 times the nominal octet rate) with a duty cycle of 32% to 68%, or for TxC to be a higher-frequency clock with some cycles omitted and with a duty cycle closer to 50%. This permits, for example, simple clocking in a DCE that recodes each 4 bits into 5 baud; the DCE could have a clock 10 times the nominal octet rate, with a duty cycle of between 40% and 60%, and would omit (the same) two cycles every octet.

TxC supports the DTE to DCE configuration and message transmission services.

8.2.2 Request to Send (RTS)

The Request To Send (RTS) signal supports the DTE to DCE reset, configuration, and message transmission services. The DTE shall source this signal. The initial (power-on) and idle (no DTE to DCE service active) state of this signal shall be low.

When referenced to Tx_C at the DTE - DCE interface, this signal shall have a minimum setup time of the smaller of either 100 ns or $0,025 P$; the hold time shall be zero or greater.

8.2.3 Clear to Send (CTS)

The Clear to Send (CTS) signal supports the DTE to DCE configuration and message transmission services. The DCE shall source this signal. The initial (power-on) and idle (no DTE to DCE service active) state of this signal shall be low.

When referenced to Tx_C at the DTE - DCE interface, this signal shall have a minimum setup time of the smaller of either 100 ns or $0,025 P$; the hold time shall be zero or greater.

8.2.4 Transmit Data (Tx_D)

The Transmit Data (Tx_D) signal supports the DTE to DCE reset, configuration, and message transmission services. Binary data is transmitted from DTE to DCE during one phase of the latter two services, and during this phase a binary 0 is represented by a low level on Tx_D and a binary 1 by a high level on Tx_D, both sampled at the falling edge of Tx_C.

The DTE shall source this signal. The initial (power-on) and idle (no DTE to DCE service active) state of this signal shall be high.

When referenced to Tx_C at the DTE - DCE interface, this signal shall have a minimum setup time of the smaller of either 100 ns or $0,025 P$; the hold time shall be zero or greater.

8.2.5 Receive Clock (Rx_C)

The Receive Clock signal (Rx_C) shall provide the DTE with an intermittent (semi-continuous) nominally two-phase timing signal which defines the timing of information being reported via the RDF signal. The DCE shall source this signal such that, where Rx_C is defined to be meaningful (see 8.3.6), each phase has a duration of at least $0,04 P$.

NOTE — This specification permits Rx_C to be a recovered clock at the nominal bit rate (8 times the nominal octet rate) with a duty cycle of 32% to 68%, or to be a higher-frequency clock with some cycles omitted and with a duty cycle closer to 50%. This permits, for example, simple clocking in a DCE that decodes 4 bits from each received 5 baud; the DCE could have a clock 10 times the nominal octet rate, with a duty cycle of between 40% and 60%, and would omit two cycles every octet.

This specification also permits the DCE to omit cycles of Rx_C during recognition of long end-delimiter sequences of PhPDUs, so that the delimiter can be reported in real time using 8 or fewer cycles of Rx_C (see 8.3.6).

Rx_C shall support the DCE to DTE message reporting service.

8.2.6 Receive Activity (Rx_A)

The Receive Activity (Rx_A) signal shall support the DCE to DTE fault notification, media-activity indication, and message reporting services. The DCE shall source this signal. The initial (power-on) and idle (no DCE to DTE service active) state of this signal shall be low.

8.2.7 Receive Data and Framing (RDF)

The Receive Data and Framing (RDF) signal shall support the DCE to DTE fault notification and message reporting services. Binary data is transmitted from DCE to DTE during some phases of the latter service, and during these phases a binary 0 is represented by a low level on RDF and a binary 1 by a high level on RDF, both sampled at the falling edge of RxC.

The DCE shall source this signal. The initial (power-on) and idle (no DCE to DTE service active) state of this signal shall be high.

When referenced to RxC at the DTE - DCE interface, this signal shall have a minimum setup time of the smaller of either 100 ns or 0,025 P ; the hold time shall be zero or greater.

8.3 Encoding of services in signals

The services of 8.1 shall be implemented by the following sequences and combinations of the signals of 8.2.

NOTE — Typical transmit and receive sequencing machines are shown in figure 3. Figure 3 is included in this part of this International Standard for explanatory purposes and does not imply a specific implementation.

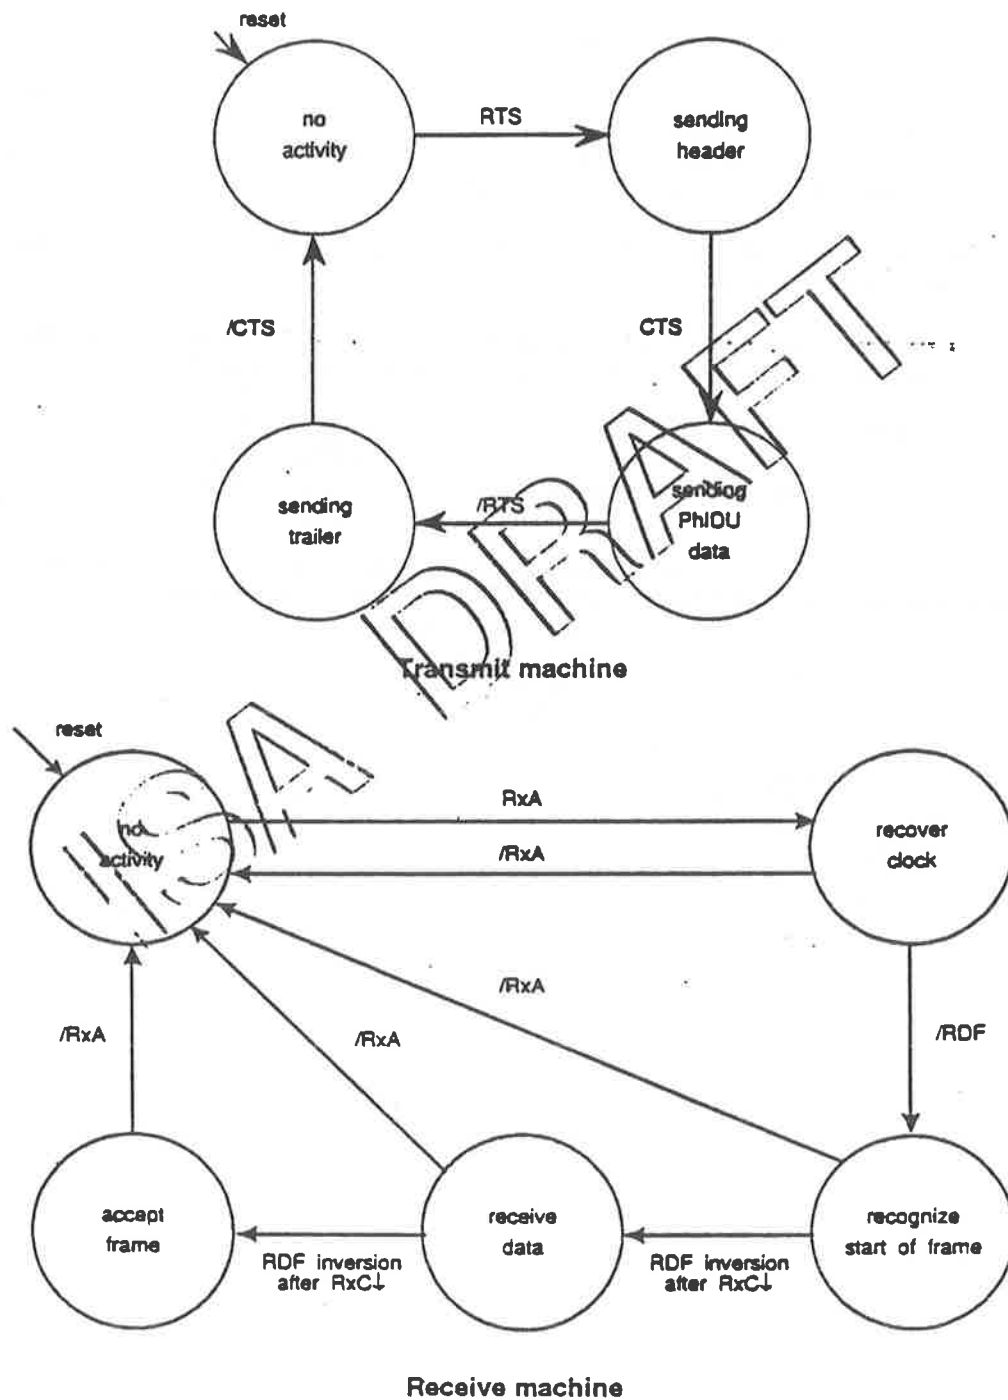


Figure 3 — DTE/DCE sequencing machines

8.3.1 DTE to DCE reset service

This service shall be mutually exclusive with the DTE to DCE configuration and message transmission services; at most one of them may be active at any given time. This service may preempt the DTE to DCE configuration and message transmission services at any time.

This service shall be encoded as a simultaneous low level on both RTS and TxD. When asserted by the DTE, this simultaneous low level shall be held for at least the nominal transmission period of two PhSDUs (octets).

NOTES

- 1 This is an asynchronous service, and is not referenced to TxC.
- 2 When a DTE is itself being reset, possibly during power-up, it should attempt to reset the DCE even when the DTE's own V_{DD} is below normal operational limits.
- 3 This reset is under the control of the DTE. It does not preclude the existence of a separate reset pin on the DCE.

If the DTE concurrently changes both RTS and TxD during the implementation of either the DTE to DCE configuration or message transmission services, then the DTE shall ensure that an interval of at least the minimum required setup time exists between changing the one signal to a high level, and subsequently changing the other signal to a low level, to eliminate potential logic hazards in the DCE's implementation of the DTE to DCE reset service.

8.3.2 DTE to DCE configuration service

This service is mutually exclusive with the DTE to DCE reset and message transmission services; at most one of them may be active at any given time. This service may initiate the DCE to DTE message reporting service to report DCE-internal status. The DTE to DCE reset service may preempt this service at any time.

This service shall be implemented in three phases; each of the latter two phases shall follow immediately upon completion of the prior phase.

NOTE 1 — These phases can be implemented as a minor variation on the three phases specified for the DTE to DCE message transmission service. As a result, the DTE to DCE configuration service induces very little added complexity on the DTE and DCE.

1) The DTE shall assert (raise) RTS after the falling edge, and before the rising edge, of TxC. The DCE shall respond by anticipating configuration data.

2) When it is ready for configuration data from the DTE, the DCE shall raise CTS before the falling edge of TxC. The DTE shall respond by encoding the first bit of configuration data (high=1, low=0) on TxD before the falling edge of the next TxC, and shall continue this process without interruption until between 2 and 200 bits of data (see 8.4) have been so encoded. The DTE shall then assert (raise) TxD and negate (lower) RTS before the falling edge of the next TxC.

NOTE 2 — The DTE shall ensure that TxD is raised at least one setup time before RTS is lowered, to avoid potential logic hazards in the DCE implementation of the DTE to DCE reset service.

3) The DCE shall conclude any necessary reconfiguration before negating (lowering) CTS, which shall occur between two consecutive falling edges of TxC.

Both standardized and extendible configuration messages are defined in 8.4. Standardized messages cover the ranges of application of this interface which are anticipated to be most cost sensitive. Extendible messages permit differing forms of DCE configuration where required, and can serve to initiate the DCE to DTE message reporting service to report DCE-internal status (a DCE option further described in 8.4).

8.3.3 DTE to DCE message transmission service

This service is mutually exclusive with the DTE to DCE reset and configuration services; at most one of them may be active at any given time. The DTE to DCE reset service may preempt this service at any time.

This service shall be implemented in three phases; each of the latter two phases shall follow immediately upon completion of the prior phase.

1) The DTE shall assert (raise) RTS after the rising edge, and before the falling edge, of TxC. The DCE shall respond by generating and transmitting the appropriate-length sequence of preamble and start delimiter PhPDUs.

2) When it is ready for transparent data from the DTE, the DCE shall raise CTS before the falling edge of TxC. The DTE shall respond by encoding the first bit of transparent data (high=1, low=0) on TxD before the next falling edge of TxC, and shall continue this process without interruption until between 3 and 300 integral octets of data have been so encoded. The DTE shall then assert (raise) TxD and negate (lower) RTS before the next falling edge of TxC.

NOTE — The DTE shall ensure that TxD is raised at least one setup time before RTS is lowered, to avoid potential logic hazards in the DCE implementation of the DTE to DCE reset service.

3) The DCE shall conclude transmission of all of the encoded transparent data received from the DTE, shall then generate and transmit the appropriate-length sequence of end delimiter PhPDUs, and shall then cease transmission. The DCE shall then wait an amount of time equal to the configured minimum post-transmission gap (see table 1) before negating (lowering) CTS, which shall occur after a falling edge, and before the next falling edge, of TxC.

8.3.4 DCE to DTE fault notification service

This service shall be mutually exclusive with the DCE to DTE media-activity indication and message reporting services; at most one of them may be active at any given time. This service may preempt the DCE to DTE media-activity indication and message reporting services at any time.

This service shall be encoded as a simultaneous low level on both RxA and RDF. Once asserted by the DCE, this simultaneous low level shall be held until activation of either the DTE to DCE reset or configuration services.

NOTE — This is an asynchronous service, and is not referenced to RxC.

The DCE may concurrently change both RxA and RDF during the concurrent termination of the DCE to DTE media-activity indication and message reporting services. The DTE is responsible for avoiding any logic hazards induced by this concurrent change.

8.3.5 DCE to DTE media-activity indication service

This service is mutually exclusive with the DCE to DTE fault notification service; at most one of them may be active at any given time. The DCE to DTE fault notification service may preempt this service at any time.

This service shall be encoded as a high level on RxA. Once asserted by the DCE, this high level enables recognition of a high-to-low transition on RDF to initiate the DCE to DTE message reporting service. Any subsequent high-to-low transition on RxA terminates that DCE to DTE message reporting service.

NOTE — The DCE to DTE media-activity indication service is an asynchronous service, and is not referenced to RxC.

8.3.6 DCE to DTE message reporting service

This service is mutually exclusive with the DCE to DTE fault notification service; at most one of them may be active at any given time. This service can only occur while the DCE to DTE media-activity indication service is active. The DCE to DTE fault notification service may preempt this service at any time.

8.3.6.1 Non-erroneous reception

This service shall be implemented in four phases when reporting a well-formed message, each of which shall follow immediately upon completion of the prior phase.

The following description applies to DCEs which have end delimiter sequences of eight PhPDUs or less, and which do not require any extra decoding delay for an FEC (forward error correcting) code. DCEs which do not meet these conditions may introduce extra delay into their decoding and reporting processes so that, with respect to signaling on RxC and RDF, they do meet these conditions.

- 1) After detecting received signaling, training on that signaling, and recovering a data clock from that signaling whose nominal octet frequency is the same as TxC, the DCE shall initiate the DCE to DTE message reporting service by sourcing that recovered clock on RxC and then negating (lowering) RDF after the rising edge, and before the next falling edge, of RxC.

NOTE 1 — RxA is already asserted at this time.

- 2) The DCE shall continue training and attempting to match the received signaling against its expected preamble and start delimiter PhPDUs.

If the DCE supports N channels of redundant media, then it may report on RDF the identity of the channel from which the signaling is being received by encoding that channel number, in the range 0 to $N-1$, as a binary number which is reported most significant bit first during reception of the last three of those start delimiter PhPDUs. The bits reported on RDF shall be presented in series after successive rising edges of RxC, each before the immediately subsequent falling edge of RxC.

Upon detecting an exact match between the received signaling and the expected start delimiter, the DCE shall invert RDF after the falling edge, and before the next rising edge, of RxC.

NOTE 2 — If the identity of the receiving channel was being reported on RDF, then this inversion will occur during the low phase of RxC which immediately follows the high phase (of RxC) during which the last (low-order) bit of the channel number was reported.

- 3) The DCE shall continue reception and attempting to match the received signaling against potential data and expected end delimiter PhPDUs.

The DCE shall report each data bit decoded from the received signaling on RDF. The bits reported on RDF shall be presented in series after successive rising edges of RxC, each before the immediately subsequent falling edge of RxC. In the absence of errors these bits shall be reported in the same order and with the same values as they were transmitted by a peer PhL entity.

NOTE 3 — This is a guarantee of transparency.

An end delimiter may be composed of both data and non-data PhPDUs. The DCE may report similarly on RDF each data bit decoded from an end delimiter, and may report also on RDF an appropriate number of data values for the non-data PhPDUs decoded from an end delimiter, except that

- a) the total number of "bits" so reported shall be 7 or less, and

b) upon detecting an exact match between the received signaling and the expected end delimiter, the DCE shall not report on RDF another bit corresponding to the end delimiter's last "bit", but rather shall first assert (raise) RDF after the rising edge, and before the next falling edge, of RxC, and then shall negate (lower) RDF after the falling edge, and before the next rising edge, of RxC.

NOTES

4 Most implementations will decode, and report on RDF as data, any initial data PhPDUs in a received end-delimiter sequence. The first non-data PhPDU, and subsequent PhPDUs, need not be reported. However, a final report will be made on RDF, indicating correct end-delimiter recognition.

5 Each reported bit, except the last, is maintained on RDF for a full cycle of RxC. The last bit is replaced by a high-low sequence, each of which is maintained for just one phase of RxC.

6 This terminating high-low sequence will occur during the first eight "bit" reports which occur after the last (pre-delimiter) data bit was reported. That last (pre-delimiter) data bit will have been the 8Nth data bit so reported in this phase, where N should be at least 3 and no greater than 300.

4) The DCE shall assert (raise) RDF before the next falling edge of RxC and shall not initiate another instance of the DCE to DTE message reporting service until after the conclusion of the current DCE to DTE media-activity indication service.

8.3.6.2 Erroneous reception

An error may be detected during any phase of the reception process described in 8.3.6.1. When that occurs, the DCE shall modify its sequencing of those phases as follows.

If the DCE should detect invalid PhPDUs, or an invalid sequence of PhPDUs, or a valid end delimiter sequence of PhPDUs which is not separated from the start delimiter PhPDUs by an integral number of data-octets of PhPDUs; and if the DCE can establish a valid signal on RxC (for example, by substituting TxC or some other local signal for the recovered clock source, if necessary); then

- a) If phase 2 has not already been initiated, then the DCE shall immediately initiate phase 2;
- b) If phase 2 has not already been concluded, then the DCE shall immediately conclude phase 2 as rapidly as possible, ignoring the requirement for matching of the start delimiter PhPDU sequence;
- c) Otherwise, the DCE shall immediately negate (lower) RDF after the rising edge, and before the next falling edge, of RxC, and then shall assert (raise) RDF after the falling edge, and before the next rising edge, of RxC.

NOTE — This sequence permits the DCE to

- enable DTE use of RxC;
- identify the channel with the erroneous signaling; and
- indicate a reception error.

When the DCE has completed as many of the above steps (a), (b) and (c) as appropriate and possible, the DCE shall immediately initiate phase 4.

8.4 DCE configuration messages

This sub-clause defines both standardized configuration messages, and the standardized portion of extendible configuration messages. Standardized messages cover the ranges of application of this interface which are anticipated to be most commonly used. Extendible messages permit differing

forms of DCE configuration where required, and can serve to initiate the DCE to DTE message reporting service to report DCE-internal status (a DCE option).

Two standardized messages, and two classes of extendible messages, are defined. All messages are transmitted across the interface in the order in which the bits are defined. Integers are transmitted most-significant-bit (MSB) first.

The two standardized messages and two classes of extendible messages are distinguished by the first two data bits of the configuration message, as follows:

- 00 — Basic configuration message
- 01 — Path-diversity control message
- 10 — Extendible configuration message
- 11 — Extendible status-report invocation message

8.4.1 Basic configuration message

Following its initial two bits of (00), the basic configuration message specifies operational aspects common to most DCEs. The defined components of this message are, in order of transmission:

- a) The operational mode of the DCE, encoded in one data bit as shown. The value for this parameter after activation of the DTE to DCE reset service is 0.

0 Two-way simultaneous (full-duplex), where each invocation of the DTE to DCE message transmission service automatically activates the DCE to DTE media-activity indication and message reporting services;

NOTE 1 — This mode is desirable for dual-channel media such as fibre-optic-pair cabling. Some DTEs may only be able to operate in this mode.

1 Two-way alternate (half-duplex), where an invocation of the DTE to DCE message transmission service does not automatically activate the DCE to DTE media-activity indication and message reporting services;

NOTE 2 — This mode minimizes DCE and DTE - DCE interface power consumption. Some DTEs may only be able to operate in this mode.

- b) The selection of the DCE-internal data source for the message reporting service, encoded in two data bits as shown. (See table 1.) The value for this parameter after activation of the DTE to DCE reset service is 00. When this selection is non-zero, transmission on all attached media shall be disabled and the DTE - DCE interface shall operate in two-way simultaneous (full-duplex) mode.

00 decoded signaling, received from one of the attached media as specified in 8.4.2(b) and 8.4.2(c). The interface mode is as specified in 8.4.1(a).

01 internal-status reporting, see 8.4.4 and 8.5.

10 loopback as close as possible to the DTE - DCE interface, with no transmission to connected media, where each invocation of the DTE to DCE message transmission service automatically activates the DCE to DTE media-activity indication and message reporting services;

NOTE 3 — This mode is desirable for DCE vs. DTE vs. inter-connect fault localization.

11 loopback as close as possible to the media interface(s), with no transmission to connected media, where each invocation of the DTE to DCE message transmission service automatically activates the DCE to DTE media-activity indication and message reporting services.

NOTE 4 — This mode is desirable for self-assessment before entry to an operating network.

c) The amount by which the preamble, which is the initial sequence of PhPDUs in each transmission, should be extended. Its range is zero to seven units of extension, encoded in three data bits as 0 (000) to 7 (111). The value for this parameter after activation of the DTE to DCE reset service is 0 (000). (See note 2 of 6.2.3.)

d) The amount by which the mandatory post-transmission gap, which is the period of non-transmission between successive sequences of PhPDUs, should be extended. Its range is zero to seven units of extension, encoded in three data bits as 0 (000) to 7 (111). The value for this parameter after activation of the DTE to DCE reset service is 0 (000). (See note 3 of 6.2.3.)

8.4.2 Path-diversity control message

Following its initial two bits of (01), the path-diversity control message specifies additional configuration data commonly required for management and fault-assessment of redundant paths: separate transmission and reception controls for each of the attached redundant media (channels and paths). The defined components of this message are, in order of transmission:

a) Two bits of zero (00), which provide quartet and octet alignment within the message for the following fields.

b) The algorithm for choosing between redundant media as the source of received signaling when more than one of the media is enabled for reception, coded in four bits as shown. The value for this parameter after activation of the DTE to DCE reset service is 0000.

0000 — The medium selected for reception should be the first medium on which signaling which is suitable for receiver-training is detected.

1000 to 1111 ($= 7 + N$, $1 \leq N \leq 8$) — The M_h medium should be selected, except when signaling suitable for receiver-training has been detected on another medium for a period of time equal to the extra period of inter-frame-gap extension specified in 8.4.1(d), in which case that other medium should be selected.

c) The selection of whether reception is enabled (0) or inhibited (1) on each of eight or fewer redundant media, coded in eight consecutive bits for channels 1 through 8, respectively. (See table 1.) The value for this parameter after activation of the DTE to DCE reset service is 0000 0000.

d) The selection of whether transmission is enabled (0) or inhibited (1) on each of eight or fewer redundant media, coded in eight consecutive bits for channels 1 through 8, respectively. (See table 1.) The value for this parameter after activation of the DTE to DCE reset service is 0000 0000.

e) The amount of post-transmission gap extension due to potential signal skew between redundant media. Its range is zero to seven units of extension, encoded in three data bits as 0 (000) to 7 (111). The value for this parameter after activation of the DTE to DCE reset service is 0 (000). (See 8.4.1(d), 8.4.2(b), and note 3 of 6.2.2.)

8.4.3 Extendible configuration messages

Following its initial two bits of (10), the coding of extendible configuration messages may be implementation dependent. The structure and form of extendible configuration messages shall be the same as the basic configuration message specified in 8.4.1.

8.4.4 Extendible status-report invocation messages

Following its initial two bits of (11), the coding of extendible status-report invocation messages may be implementation dependent. The structure and form of extendible status-report invocation messages shall be the same as the basic configuration message specified in 8.4.1. The information specified shall select some DCE-internal source of received signaling, and if the DCE-internal-data-source mode is status-reporting (see 8.4.1(b)), then the DCE shall generate a multi-data-octet message, padded as necessary to an octet multiple, and shall report it using the DCE to DTE media-activity indication and message reporting services.

8.5 DCE-generated status reports

These reports are generated within the DCE upon request, and reported when the DCE-internal-data-source is internal-status report. (See 8.4.1(b)).

9 Medium Dependent Sublayer (MDS) : Wire media

NOTE — The Medium Dependent Sublayer (MDS) is part of the Data Communication Equipment (DCE). It exchanges serial PhSDU sequences across the DTE - DCE interface specified in clause 8 and it communicates encoded bits across the MDS - MAU interface specified in Clause 10. The MDS functions are logical encoding and decoding for transmission and reception respectively and the addition/removal of preamble and delimiters together with timing and synchronization functions.

9.1 PhPDU

The MDS shall produce the PhPDU shown in figure 4 by adding preamble and delimiters to frame the serial sequence of PhSDUs (bits) transferred from the DIS across the DTE - DCE interface. Transmission sequence shall be from left to right as shown in figure 4, i.e. preamble first, followed by start delimiter, PhSDU sequence and finally end delimiter.



Figure 4 — Protocol Data Unit (PhPDU)

Conversely the MDS shall remove preamble and delimiters from a received PhPDU to produce a corresponding serial sequence of PhSDUs. Any non-binary data unit which is detected in the received PhSDU sequence shall be reported as Ph-DATA indication (PhIDU, error).

9.2 Encoding and decoding

Data units shall be encoded by the MDS for application to the MAU using the code shown in figure 5 (Manchester Biphase L). The encoding rules are formally given in figure 6 and table 5.

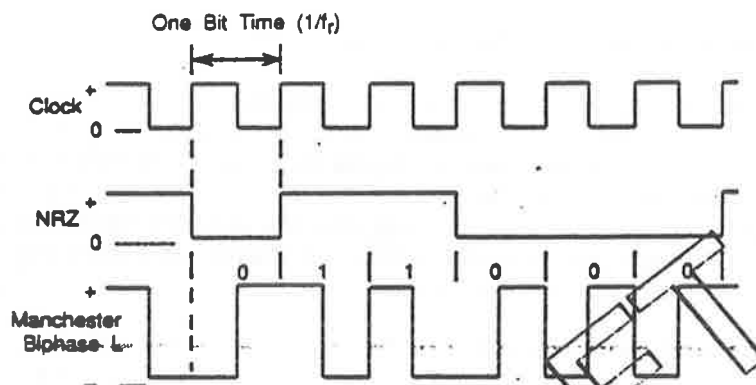


Figure 5 — PhSDU encoding and decoding

NOTE 1 — Figure 5 is included in this part of this International Standard for explanatory purposes and does not imply a specific implementation.

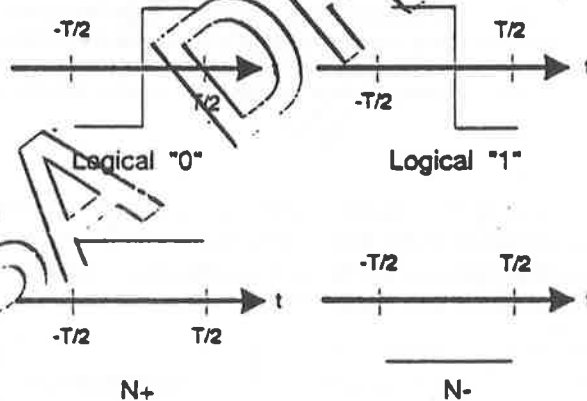


Figure 6 — Encoding rules

Table 5 — Encoding rules

Symbols	Encoding
1 (ONE)	Hi-Lo transition (mid-bit)
0 (ZERO)	Lo-Hi transition (mid-bit)
N+ (NON-DATA PLUS)	Hi (No transition)
N- (NON-DATA MINUS)	Lo (No transition)

NOTE 2 — It may be seen that data symbols (1 and 0, conveyed by PhSDUs) are encoded to always contain a mid-bit transition. Non-data symbols (N+ and N-) are encoded so that they never have a mid-bit transition. Frame delimiters (see 9.4 and 9.5) are constructed so that non-data symbols are conveyed in pairs of opposite polarity.

Decoding shall normally be the opposite of encoding. At reception, the MDS shall verify that each symbol is encoded in accordance with figure 6 and table 5 and shall detect the following errors:

- a) invalid Manchester code;

b) half-bit-slip errors.

Any of these errors shall be reported as Ph-DATA indication (PhIDU, error).

9.3 Polarity detection

The option of automatic polarity detection of the received Manchester encoded signal shall be required where it is specified in the relevant MAU.

9.4 Start of frame delimiter

The following sequence of symbols, shown from left to right in order of transmission, shall immediately precede the PhSDU sequence to delimit the start of a frame:

1, N+, N-, 1, 0, N-, N+, 0.

(shown as a waveform in figure 7)

The MDS shall only accept a received signal burst as a PhPDU after verifying this sequence and shall remove this sequence before transferring the PhSDU sequence to the DIS.

9.5 End of frame delimiter

The following sequence of symbols, shown from left to right in order of transmission, shall immediately follow the PhSDU sequence to delimit the end of a frame:

1, N+, N-, N+, N-, 1, 0, 1.

(shown as a waveform in figure 7)

The MDS shall remove this sequence from the PhPDU before transferring the PhSDU sequence to the DIS. The MDS shall report to the corresponding Data Link Layer entity any frames received via the medium which do not include this sequence within 300 octets of start of frame (from beginning of start delimiter) as Ph-DATA indication (PhIDU, frame_too_long). The MDS shall report to the corresponding Data Link Layer entity, via the corresponding DIS, any frames received via the medium which have an end delimiter which is not located at an octet boundary as Ph-DATA indication (PhIDU, received_timing_error).

9.6 Preamble

In order to synchronize bit times a preamble shall be transmitted at the beginning of each PhPDU consisting of the following sequence of bits, shown from left to right in order of transmission:

1, 0, 1, 0, 1, 0, 1, 0.

(shown as a waveform in figure 7)

NOTE — Received preamble can contain as few as four bits due to loss of one bit through each of four repeaters (as specified in the MAU Network Configuration Rules).

The period may be extended, but not reduced, by Station Management as given in table 1. A preamble extension sequence as listed in table 1 shall be defined as the following sequence of bits, shown from left to right in order of transmission:

1, 0, 1, 0, 1, 0, 1, 0.

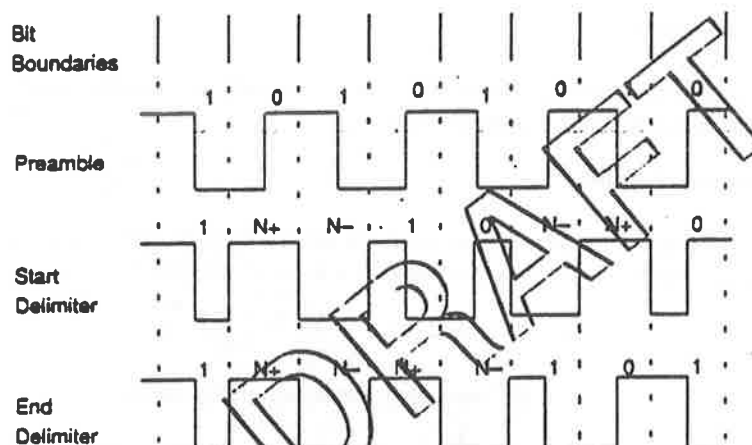


Figure 7 — Preamble and delimiters

NOTE — These waveforms do not extend the frequency range outside the band required for transmission of binary PhSDUs (conveying data symbols) in accordance with figure 6 and table 5.

9.7 Synchronization

After the reception of the fourth bit of the frame and until end of frame or frame termination the receiver shall detect and report half-bit-slip errors.

NOTE 1 — This synchronization specification allows the loss of four bits of the preamble.

After the preamble, half-bit-slip errors shall be reported as Ph-DATA indication (PhIDU, error).

NOTE 2 — Half-bit-slip errors can be detected as excessive bit cell jitter and/or excessive variation in bit period.

9.8 Post-transmission gap

After transmission of a PhPDU there shall be a minimum period during which a subsequent transmission shall not commence. For the same minimum period after reception of a PhPDU the receiving Physical Layer entity shall ignore all received signaling. An MDS entity shall set a minimum post transmission period of four nominal bit times. The period may be extended, but not reduced, by Station Management as given in table 1 or by an associated MAU entity. A gap extension sequence as listed in table 1 shall be defined as four nominal bit times,

NOTE — The MAU transmit enable/disable time may reduce the duration of silence between frames.

9.9 Inter-channel signal skew

If the device is configured (by Station Management) to receive concurrently on more than one channel then the maximum accepted differential delay between any two active channels, as measured from the first PhPDU of a start delimiter, shall not exceed five nominal bit times. This period may be extended, but not reduced, by Station Management as given in table 1. A gap extension sequence

as listed in table 1 shall be defined as four nominal bit times. The value of post-transmission gap shall be greater than the value of inter-channel skew.

10 MDS - MAU interface : Wire media

NOTE — The Medium Attachment Unit (MAU) is an optionally separate part of a communication element which connects to the medium directly or via passive components. For electrical signaling variants the MAU is the transceiver, which provides level shifting and wave shaping for transmitted and received signals. The MDS - MAU interface links the MAU to the MDS. The services are defined as physical signals to facilitate this interface being optionally exposed. Table 6 lists the minimum set of required services at the MDS - MAU interface. See clause 6 for management services.

10.1 Services

If the MDS - MAU interface is exposed it shall support at least the set of required services given in table 6 and specified in 10.2.

Table 6 — Minimum services at MDS - MAU interface

Service	Abbreviation	Direction
Required:		
Transmit Signal	TxS	To MAU
Receive Signal	RxS	From MAU
Transmit Enable	TxE	To MAU
Optional:		
Loopback enable	LbE	To MAU

10.2 Service specifications

10.2.1 Transmit Signal (TxS)

The Transmit Signal service (TxS) shall transfer the encoded PhPDU signal sequence across the MDS - MAU interface to the MAU, where the sequence shall be transmitted onto the medium if the Transmit Enable (TxE) is set to logic 1 (high level).

10.2.2 Receive Signal (RxS)

The Receive Signal service (RxS) shall transfer the encoded PhPDU signal sequence or silence across the MAU - MDS interface to the MDS. The RxS shall echo the signal transmitted via TxS by simultaneously receiving the transmissions from the medium.

10.2.3 Transmit Enable (TxE)

The Transmit Enable service (TxE) shall provide the MDS with the facility to enable the MAU to transmit. The TxE shall be set to logic 1 (high level) at the commencement of preamble transmission and then set to logic 0 (low level) after the last bit of the end delimiter has been transmitted.

If redundant media are in use and the method of implementing redundancy is to receive on all channels but transmit on only one then the channel (cable) which is currently used for transmission shall be selected by setting its TxE to logic 1 (high level). All channels which are not currently in use for transmission shall be disabled by setting the TxE to logic 0 (low level).

10.2.4 Loopback Enable (LbE)

If the optional Loopback Enable (LbE) service shown in table 1 is used it shall disable the final output stage of the MAU transmit circuit, connect the output of the previous stage of the MAU transmit circuit to the MAU receive circuit and disconnect the MAU receive circuit from the medium. The state of the Loopback Enable shall not change while the MAU is transmitting or receiving.

NOTE — This is confirmation service of local significance only which provides a device with the facility to test the integrity and functionality of the Physical Layer circuitry, excluding the medium.

10.3 Signal characteristics

Timing characteristics shall be compatible with those specified in the requirements of this standard for the relevant MDS.

If the MDS - MAU interface is exposed it shall operate with signal levels as shown in table 7. Both sides of the interface shall operate with the same value of V_{DD} .

Table 7 — Signal levels for an exposed MDS - MAU interface

Symbol	Parameter	Conditions	Limits	Units	Remarks
V_{OL}	Maximum low-level output voltage	$I_{out} = \pm 100 \mu A$	0,1	V	See Note 1
		$I_{out} = +1,6 \text{ mA}$	0,4	V	
V_{OH}	Minimum high-level output voltage	$I_{out} = \pm 100 \mu A$	$V_{DD} - 0,1$	V	See Note 1
		$I_{out} = -0,8 \text{ mA}$	$V_{DD} - 0,8$	V	See Note 2
V_{IL}	Maximum low-level input voltage		$0,2 V_{DD}$	V	
V_{IH}	Minimum high-level input voltage		$0,7 V_{DD}$	V	See Note 3
<p>NOTES</p> <p>1 Provides the capability to drive two typical CMOS loads.</p> <p>2 CMOS input compatibility with TTL output requires a "pull-up" resistor from signal input to V_{DD}.</p> <p>3 Compatible with CMOS output for $3,0 \text{ V} \leq V_{DD} \leq 5,5 \text{ V}$. Compatibility with TTL output ($4,75 \text{ V} \leq V_{DD} \leq 5,25 \text{ V}$) requires a "pull-up" resistor from signal input to V_{DD}.</p>					

10.4 Communication mode

The communication mode at this interface shall allow simultaneous transmission and reception.

10.5 Timing characteristics

The MDS - MAU interface shall function correctly with a PhSDU bit rate of between 1 kbit/s and 1,1 times the highest stated MAU bit rate.

NOTE — The bit rates available in an implementation are stated in the Protocol Implementation Conformance Statement (PICS).

11.7.5 Terminator

A terminator shall be located at both ends of the trunk cable, connected from one signal conductor to the other. No connection shall be made between terminator and cable shield.

The terminator impedance value shall be $100 \Omega \pm 2\%$ over the frequency range $0,25 f_r$ to $1,25 f_r$ (7,8 kHz to 39 kHz).

NOTE 1 — This value is approximately the average cable characteristic impedance value for suitable cables at the relevant frequencies and is chosen to minimize transmission line reflections.

The direct current leakage through the terminator shall not exceed 100 μ A. The terminator shall be non-polarized.

All terminators used for I.S. applications shall comply with isolation requirements (creepage and clearance) commensurate with the required I.S. approval. Terminators for non-I.S. applications shall not be required to have I.S. approval.

NOTE 2 — It is acceptable for the functions of power supply, safety barrier, and terminator to be combined in various ways as long as the impedance of the combination is equivalent to the parallel impedance of independent devices meeting the requirements of this Standard and the network configuration rules of 11.2.2 are followed.

11.7.6 Shielding rules

Where conformance to the noise immunity requirements of 11.4 is to be met by the use of shielding it is necessary to ensure the integrity of shielding throughout the cabling, connectors and couplers by the following means.

- a) the coverage of the cable shield shall be greater than 90% of the full cable length;
- b) shielding shall completely cover the electrical circuits in connectors, couplers, and splices.

NOTE — Deviation from these shielding rules may degrade noise immunity.

11.7.7 Grounding rules

NOTE 1 — Grounding means permanently connected to earth through a sufficiently low impedance and with sufficient current carrying capability to prevent voltage build up which might result in undue hazard to connected equipment or persons. Zero volts (common) lines may be connected to ground where they are galvanically isolated from the Field Bus trunk.

Field Bus devices shall be required to function to the requirements of this part of this International Standard with the mid-point of one terminator or one inductive coupler connected directly to ground.

Field Bus devices shall not connect either conductor of the twisted pair to ground at any point in the network. Signals shall be applied and preserved differentially throughout the network.

NOTE 2 — It is standard practice for the shield of the Field Bus trunk cable (if applicable) to be effectively grounded at one point along the length of the cable. For this reason Field Bus devices should allow d.c. isolation of the cable shield from ground. It is also standard practice to connect the signal conductors to ground in a balanced manner at the same point, e.g. by using the center tap of a terminator or coupling transformer. For bus powered systems the grounding of the shield and balanced signal conductors would be close to the power supply unit. For I.S. systems the grounding would be at the safety barrier earth connection. Capacitive coupling between the shield or the balanced signal conductors and device local ground for EMI control is permitted subject to I.S. requirements.

11.8 Intrinsic Safety

NOTE — This standard does not attempt to list the requirements by which an item of equipment may be certified as intrinsically safe nor does it require equipment to be intrinsically safe. Rather, it seeks to exclude conditions or situations that would prevent I.S. certification.

11.8.1 Intrinsic safety barrier

The barrier impedance shall be greater than 460Ω at any frequency in the range $0,25 f_r$ to $1,25 f_r$ (7,8 kHz to 39 kHz). The I.S. barrier impedance specification shall apply to all barriers used as part of the Physical Layer, whether installed as a separate item of network hardware or embedded in a power supply card. The barrier impedance shall be measured across the terminals on both sides of the barrier. The barrier impedance shall be measured while the network power supply is set at the rated working voltage (not safety voltage) of the barrier.

NOTE — It is acceptable for the functions of power supply, safety barrier, and terminator to be combined in various ways as long as the impedance of the combination is equivalent to the parallel impedance of independent devices meeting the requirements of this Standard and the network configuration rules of 11.2.2 are followed.

At the rated working voltage of the barrier, and at any frequency in the range $0,25 f_r$ to $1,25 f_r$ (7,8 kHz to 39 kHz), the capacitance measured from the "+" (positive) network terminal (hazardous side) to ground shall differ by no more than 250 pF from the capacitance measured from the "-" (negative) network terminal (hazardous side) to ground.

11.8.2 Barrier and terminator placement

A barrier shall be separated from the nearest terminator by no more than 100 m of cable.

NOTE — The barrier can appear as a shunt impedance as low as 400Ω at the signaling frequencies. The terminator resistance is sufficiently low that when it is placed in parallel with the barrier impedance, the resulting impedance is almost entirely resistive (non-reactive).

11.9 Galvanic Isolators

The communications characteristics of galvanic isolators used on the Field Bus shall comply with the specifications of 11.8.

12 Medium Attachment Unit (MAU) : 1,0 Mbit/s, voltage-mode, wire medium

NOTES

- 1 The 1,0 Mbit/s voltage-mode MAU requirements are not specifically intended to facilitate the options of power distribution via the signal conductors and suitability for Intrinsic Safety certification. If bus powered, power is distributed as direct voltage and current, and communications signals are superimposed on the d.c. power.
- 2 The network medium consists of shielded twisted-pair cable. Independent of topology, all attached devices, other than possibly the transmitting device, are high impedance to prevent significant network loading. Trapezoidal waveforms are used to reduce electromagnetic emissions and signal distortion.
- 3 A linear bus topology is supported. A network contains one trunk cable, terminated at both ends. Spurs are distributed along the length of the trunk.

12.1 Transmitted bit rate

The transmitted bit rate shall be $1,0 \text{ Mbit/s} \pm 0,01\%$, averaged over a frame having a minimum length of 16 octets. The instantaneous bit time shall be $1,0 \mu\text{s} \pm 0,025 \mu\text{s}$.

12.2 Network specifications

NOTE — A 1,0 Mbit/s voltage-mode MAU operates in a network composed of the following components:

- a) Cable;
- b) Terminators;
- c) Couplers;

d) Devices (containing at least one communication element).

A wire network in 1,0 Mbit/s voltage mode may additionally include the following components:

e) Connectors;

f) Power supplies;

g) Devices which include power supplies.

12.2.1 Topologies

A wire MAU shall operate in a network with a linear bus topology, consisting of a trunk, terminated at each end in as specified in 12.7.5; to which communication elements are connected via couplers and spurs. Each communication element shall be connected in parallel with the trunk cable.

NOTES

- 1 The coupler and communication element may be integrated in one device (i.e. zero length spur).
- 2 Tree topology with all the communication elements located at the ends of the trunk is regarded as a special case of a bus for the purpose of this part of this International Standard.
- 3 Several communication elements may be connected to the trunk at one point using a multi-port coupler. An active coupler may be used to extend a spur to a length which requires termination to avoid reflections and distortions. Active repeaters may be used to extend the length of the trunk beyond that of a single segment as permitted by the network configuration rules.

12.2.2 Network configuration rules

A 1,0 Mbit/s voltage-mode MAU shall be required to conform to the requirements of this part of this International Standard when used in a network which complies with these rules.

Rule 1: One Field Bus shall be capable of communication between two and 32 devices, all operating at the same bit rate.

NOTE 1 — Rule 1 does not preclude the use of more than the specified number of devices in an installed system.

Rule 2: A fully loaded (maximum number of connected devices) 1,0 Mbit/s voltage-mode Field Bus segment shall have a total cable length, including spurs, between any two devices, of up to 750 m.

NOTE 2 — 750 m maximum cable length is the requirement for conformance to this standard but this does not preclude the use of longer lengths in an installed system.

Rule 3: The total number of waveform regenerations by repeaters and active couplers between any two devices shall not exceed four.

Rule 4: The maximum propagation delay between any two devices shall not exceed 40 nominal bit times.

NOTE 3 — For efficiency of the network, that part of the turnaround time of any device on the network caused by a PhE between the end of a received frame and the beginning of the transmitted frame containing an associated immediate response should not exceed 5 bit times, no more than 2 bit times of which should be due to the MAU. As it is not mandatory to expose the DLL-PhL interface or the MDS-MAU interface, that part of the turn-around time of a Field Bus device caused by the PhL or the MAU cannot be specified or conformance tested.

Rule 5: The Field Bus shall be capable of continued operation while a device is being connected or disconnected. Data errors induced during connection or disconnection shall be detected.

Rule 6: For a 1,0 Mbit/s wire Field Bus which is not powered via the signal conductors, a single failure in any one communication element or spur (including a short circuit, but excluding jabber) shall not interfere with transactions between other communication elements for more than 1 ms.

Rule 7: In polarity sensitive systems the medium twisted pairs shall have distinctly marked conductors which uniquely identify individual conductors. The polarization shall be maintained at all connection points.

Rule 8: The degradation of the electrical characteristics of the signal, between any two devices, due to attenuation, attenuation distortion and mismatching shall be limited to the values indicated below.

a) **Signal attenuation:** The configuration of the bus (trunk and spur lengths, number of devices, and possible matching devices) shall be such that the attenuation between any two devices at the frequency corresponding to the bit rate shall not exceed 17 dB;

b) **Attenuation distortion:** The configuration of the bus (trunk and spur lengths and number of devices) shall be such that between any two devices:

$$[\text{Attenuation}(1,25 f_r) - \text{Attenuation}(0,25 f_r)] \leq 8 \text{ dB}$$

$$\text{Attenuation}(1,25 f_r) \geq \text{Attenuation}(0,25 f_r)$$

where f_r is the frequency corresponding to the bit rate. Attenuation shall be monotonic for all frequencies from $0,25 f_r$ to $1,25 f_r$ (250 kHz to 1.25 MHz);

c) **Mismatching Distortion:** Mismatching (due to spurs or any other effect, including one open circuit spur of maximum length) on the bus shall be such that, at any point along the trunk, in the frequency band $0,25 f_r$ to $1,25 f_r$ (250 kHz to 1.25 MHz):

$$|(Z - Z_0) / (Z + Z_0)| \leq 0,2$$

where Z_0 is the characteristic impedance of the trunk cable and Z is the parallel combination of Z_0 and the load impedance at the coupler.

NOTE 4 — Rule 8 minimizes restrictions on trunk and spur length, number of devices etc. by specifying only the transmission limitations imposed by combinations of these factors. Different combinations may be used depending on the needs of the application.

NOTE 5 — The main cause of a large mismatch is the concentration of several couplers on a short length of the trunk.

If the distance between two consecutive couplers is less than 4 m the propagation delay between them is smaller than 20 ns (1/10 of the maximum rise or fall times specified for the transmit signal) and the concentration appears as a single mismatched element inducing large reflections of the signal transitions.

A concentration of couplers where the distance between two consecutive couplers is less than 4 m is defined as a cluster.

In order to comply with the Rule 8c using devices with an input impedance of minimum value (8 kΩ) and zero length spurs, it is recommended that a cluster would not include more than four couplers.

Using devices with an input impedance significantly higher than the minimum value would allow clusters with more couplers. Using non-zero length spurs could require clusters to have fewer than four couplers.

NOTE 6 — It is possible to reduce the mismatching due to a cluster by following means:

— using active multipoint couplers;

— inserting matching devices (passive attenuators) on each side of the cluster, under the condition that the Rule 8b is satisfied.

Rule 9: The following rules shall apply to systems implemented with redundant media:

- a) each channel (cable) shall comply with the network configuration rules;
- b) there shall not be a non-redundant segment between two redundant segments;
- c) repeaters shall also be redundant;
- d) if the system is configured (by Station Management) to transmit on more than one channel simultaneously then the propagation time difference between any two devices on any two channels shall not exceed five bit times;
- e) channel numbers shall be maintained throughout the Field Bus, i.e. channels 1,2,3... from Station Management shall always connect to physical channels 1,2,3...

12.2.3 Power distribution rules for network configuration

The cable shield shall not be used as a power conductor.

12.3 Transmit circuit specification for 1,0 Mbit/s voltage-mode MAU

NOTE — For ease of reference, the requirements of 12.3 are summarized in tables 13 and 14.

Table 13 — Transmit level specification summary for 1,0 Mbit/s voltage-mode MAU

Transmit level characteristics, values referred to trunk (but measured using test load as shown in figure 16)	Limits for 1,0 Mbit/s voltage mode
Output level, (peak-to-peak, see figure 17) With test load (non-standard for this test)	5,5 V to 9,0 V 50 Ω \pm 1%
Maximum positive and negative amplitude difference (signalling bias) as shown in figure 18	\pm 0,45 V
Output Level; open circuit, (peak-to-peak)	\leq 30,0 V
Maximum output signal distortion; i.e., overvoltage, ringing and droop (See figure 17)	\pm 10%
Quiescent transmitter output; i.e. transmitter noise (measured over the frequency band 1 kHz to 4 MHz)	\leq 5 mV (r.m.s.)

Table 14 — Transmit timing specification summary for 1,0 Mbit/s voltage-mode MAU

Transmit timing characteristics, values referred to trunk (but measured using test load as shown in figure 16)	Limits for 1,0 Mbit/s voltage mode
Transmitted bit rate	1,0 Mbit/s $\pm 0,01\%$
Instantaneous bit time	1,0 μ s $\pm 0,025 \mu$ s
Rise and fall times (10% to 90% of pk-pk signal, see figure 17)	$\leq 0,2$ nominal bit time
Slew rate (at any point from 10% to 90% of pk-pk signal)	$\leq 100 \text{ V}/\mu$ s
Maximum transmitted bit cell jitter (zero-crossing point deviation, see figure 18)	$\pm 0,025$ nominal bit time
Transmit enable/disable time (i.e. time during which the output waveform may not meet the transmit requirements)	$\leq 2,0$ nominal bit times

12.3.1 Test Configuration

Figure 16 shows the configuration which shall be used for testing.

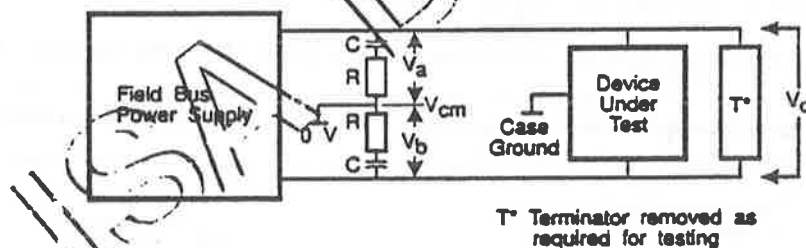


Figure 16 — Transmit circuit test configuration

Differential signal voltage: $V_d = V_a - V_b$

Test load resistance $R = 75 \Omega$ (0,5 cable Z_0) and $C = 0,33 \mu$ F except where otherwise stated in a specific requirement.

12.3.2 Output level requirements

NOTE — Figure 17 shows an example of the a.c. component of one cycle of a Field Bus waveform, illustrating some key items from the transmit circuit specification. Only signal voltages are shown; this diagram takes no account of power supply voltages.

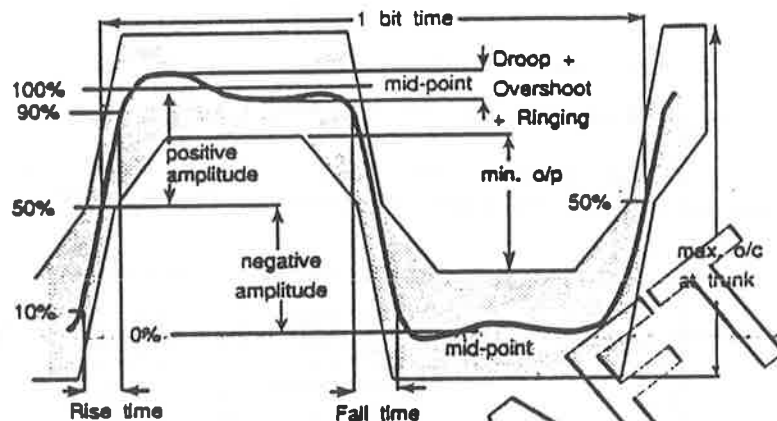


Figure 17 — Output waveform

A 1,0 Mbit/s voltage-mode MAU transmit circuit shall conform to the following output level requirements, all amplitudes being measured at the estimated mid-point between any peaks or troughs in the top and bottom of the waveform ("mid-point" in figure 17):

- the output voltage across the test load after transformer step up/down (if applicable) shall be between 5,5 V and 9,0 V peak-to-peak for all load resistances from $50 \Omega \pm 1\%$ to $75 \Omega \pm 1\%$ ("min o/p" in figure 17);
- the output voltage at the trunk, or at the transmit terminals, with any load including an open circuit shall not exceed 30,0 V peak-to-peak ("max o/c at trunk" in figure 17). For test purposes open circuit shall be defined as a load of 100 k Ω resistance in parallel with 15 pF capacitance;
- during transmission a device shall not suffer permanent failure when a load resistance of $\leq 1 \Omega$ is applied for 1 second;
- the difference between positive amplitude and negative amplitude, measured as shown in figure 18, shall not exceed $\pm 0,45$ V peak;
- the output noise from a 1,0 Mbit/s voltage-mode MAU which is receiving or not powered shall not exceed 5 mV r.m.s., measured differentially over the frequency band 1 kHz to 4 MHz, referred to the trunk;
- the differential voltage across the test load shall be such that the voltage monotonically changes between 10% and 90% of peak-to-peak value. Thereafter, the signal voltage shall not vary more than $\pm 10\%$ of peak-to-peak value until next transition occurs. This permitted variation shall include all forms of output signal distortion, i.e. overvoltage, ringing and droop.

12.3.3 Output timing requirements

A 1,0 Mbit/s voltage-mode MAU transmit circuit shall conform to the following output timing requirements:

- rise and fall times, measured from 10% to 90% of the peak-to-peak signal amplitude shall not exceed 0,2 nominal bit time (see figure 17);
- slew rate shall not exceed 100 V/ μ s measured at any point in the range 10% to 90% of the peak-to-peak signal amplitude (see figure 17);

NOTE — Requirements a) and b) produce a trapezoidal waveform at the transmit circuit output. Requirement b) limits the level of interference emissions which may be coupled to adjacent circuits etc. Requirement b) is calculated from the formula:

$$\text{Max. slew rate} = 3 \times \text{Min. slew rate} = 3 \times 0,8 V_0 / 0,2 T = 12 \times V_0 / T$$

where V_0 is the maximum pk-pk output voltage (9,0 V), and T is the nominal bit time (1 μ s).

c) transmitted bit cell jitter shall not exceed $\pm 0,025$ nominal bit time from the ideal zero crossing point, measured with respect to the previous zero crossing (see figure 18);

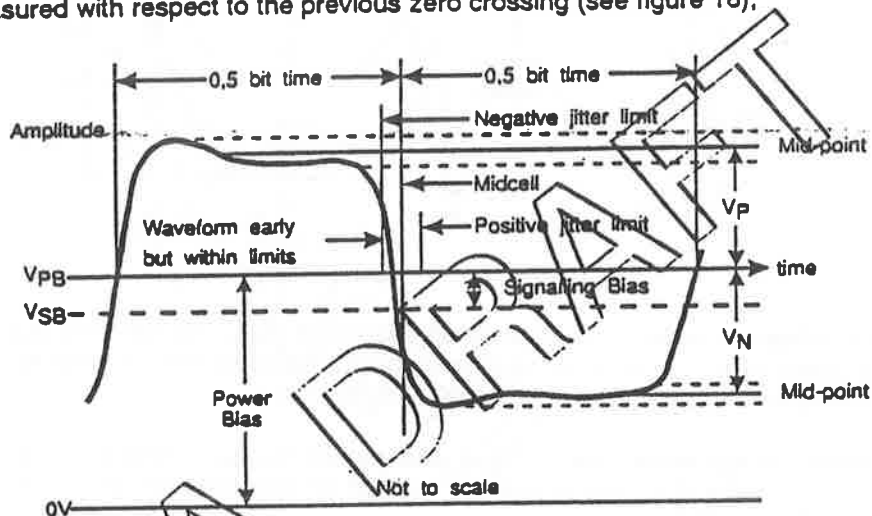


Figure 18 — Transmitted bit cell jitter (zero crossing point deviation)

d) the transmit circuit shall turn on, i.e. the signal shall rise from below the transmit circuit maximum output noise level as specified in 12.3.2 (e) to full output level, in less than 2 nominal bit times. The waveform corresponding to the third and later bit times shall be as specified by other parts of 12.3;

e) the transmit circuit shall turn off, i.e. the signal shall fall from full output level to below the transmit circuit maximum output noise level as specified in 12.3.2 (e), in less than 2 nominal bit times. The time for the transmit circuit to return to its off state impedance shall not exceed 4 nominal bit times. For the purposes of testing, this requirement shall be met with the transmit circuit test configuration of 12.3.1 with the equivalent capacitance of a maximum length cable across the DUT terminals.

NOTE — This requirement is to ensure that the transition of the transmit circuit from active to passive leaves the line capacitance fully discharged.

12.4 Receive circuit specification for 1,0 Mbit/s voltage-mode MAU

NOTE — For ease of reference, the requirements of 12.4 are summarized in table 15.

Table 15 — Receive circuit specification summary for 1,0 Mbit/s voltage-mode MAU

Receive circuit characteristics (values referred to trunk)	Limits for 1,0 Mbit/s voltage mode
Input impedance, measured over the frequency range $0,25 f_r$ to $1,25 f_r$	$\geq 8 \text{ k}\Omega$
Sensitivity; min. pk-pk signal required to be accepted (see figure 19)	700 mV
Noise rejection; max. pk-pk noise required to be rejected (see figure 19)	280 mV
Maximum received bit cell jitter (zero-crossing point deviation, see figure 20)	$\pm 0,10$ nominal bit time

12.4.1 Input impedance

The differential input impedance of a 1,0 Mbit/s voltage-mode MAU receive circuit shall be no less than $8 \text{ k}\Omega$ over the frequency range $0,25 f_r$ to $1,25 f_r$ (250 kHz to 1,25 MHz). This requirement shall be met in the power-off and power-on (not transmitting) states and in transition between these states. This impedance shall be measured at the communication element terminals using a sine wave with a signal amplitude greater than the receiver sensitivity threshold and lower than 9,0 V peak-to-peak.

NOTE — The requirement for $\geq 8 \text{ k}\Omega$ input impedance during power-up and power-down may be met by automatic disabling of the transmitter during these periods.

12.4.2 Receiver sensitivity and noise rejection

A 1,0 Mbit/s voltage-mode MAU receive circuit shall be capable of accepting an input signal of amplitude no less than 700 mV peak-to-peak, including overvoltage and oscillation (see "signal level" in figure 19 together with "positive amplitude" and "negative amplitude" in figure 17).

A 1,0 Mbit/s voltage-mode MAU receive circuit shall not respond to an input signal with a peak-to-peak amplitude which does not exceed 280 mV (see "noise rejection" in figure 19).

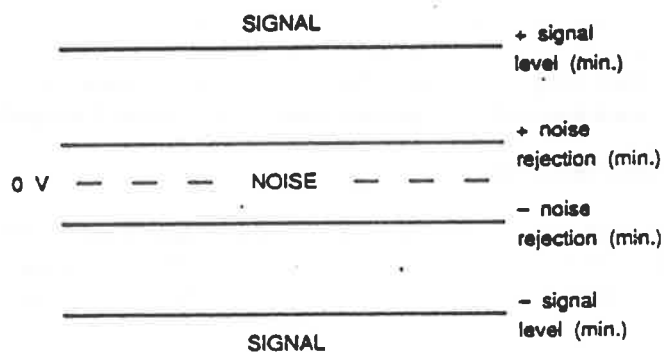


Figure 19 — Receiver sensitivity and noise rejection

12.4.3 Interference susceptibility and error rates

NOTE 1 — When the Field Bus is operating in a variety of standard noise environments the probability that an Application Layer User Data Unit contains an undetected error, due to operation of the conveying Physical and Data Link Layer entities, should be less than 1 in 10^{12} (1 error in 20 years at 1 600 messages/s). A communication element is regarded as conforming to this theoretical requirement when it meets the following interference susceptibility requirements. These are specified by a detected frame error rate which is derived by using a ratio of detected to undetected errors of 10^6 . This follows the IEEE 802 Functional Requirements Document Draft 5.9, sections 5.6.1 and 5.6.2 and should be readily achievable with a 16 bit Frame Check Sequence at the Data Link Layer.

A communication element which includes a 1,0 Mbit/s voltage-mode MAU, operating with frames containing 64 random user data bits, with maximum frame rate and with signals of 1,4 V pk-pk amplitude, shall produce no more than 3 detected frame errors in 3×10^6 frames during operation in the presence of common mode voltage or Gaussian noise as follows:

- a) a common mode sinusoidal signal of any frequency from 63 Hz to 2 MHz, with an amplitude of 4 V r.m.s. and from 47 Hz to 63 Hz with an amplitude of 250 V r.m.s.;
- b) a common mode d.c. signal of ± 10 V;
- c) white Gaussian additive differential noise in the frequency band 1 kHz to 4 MHz, with a noise density of 30 $\mu\text{V}/\text{Hz}$ r.m.s.

NOTE 2 — The common mode voltage and Gaussian noise specifications are for receive circuit conformance testing with balanced loads and are not indicative of system installation practice.

A communication element which includes a 1,0 Mbit/s voltage-mode MAU, operating with frames containing 64 random user data bits, at an average of 1-600 messages per second, with signals of 1,4 V pk-pk amplitude, shall produce no more than 3 detected frame errors in 100 000 frames during operation in the presence of electromagnetic or electrical interference environments as follows:

- 1) 10 V/m electromagnetic field as specified in IEC 801.3 at severity level 3;
- 2) electrical fast transient as specified in IEC 801.4 at severity level 3.

The above error rate specification shall also be satisfied after but not during operation in the following noise environments:

- i) 8 kV electrostatic discharge to exposed metalwork as specified in IEC 801.2 at severity level 3. If the device suffers temporary loss of function or performance as a result of this test it shall recover from any such loss without operator intervention within 3 seconds after the end of the test;
- ii) high frequency disturbance tests as specified in IEC 255-4 Appendix E, Test voltage class III (2,5 kV and 1 kV peak values of first half-cycle in longitudinal and transverse mode respectively). If the device suffers temporary loss of function or performance as a result of this test it shall recover from any such loss without operator intervention within 3 seconds after the end of the test.

12.4.4 Received bit cell jitter

The receive circuit shall accept a Manchester encoded signal transmitted in accordance with 12.1 and 12.3. In addition, the receiver shall accept signals with the time variation between any two adjacent signal transition points (zero crossing) of no greater than $\pm 0,10$ nominal bit time. See figure 20.

NOTES

- 1 This does not preclude the use of receivers which perform better than this specification.
- 2 Depending on the symbol pattern, the nominal time between zero crossings may be one-half or one bit time.

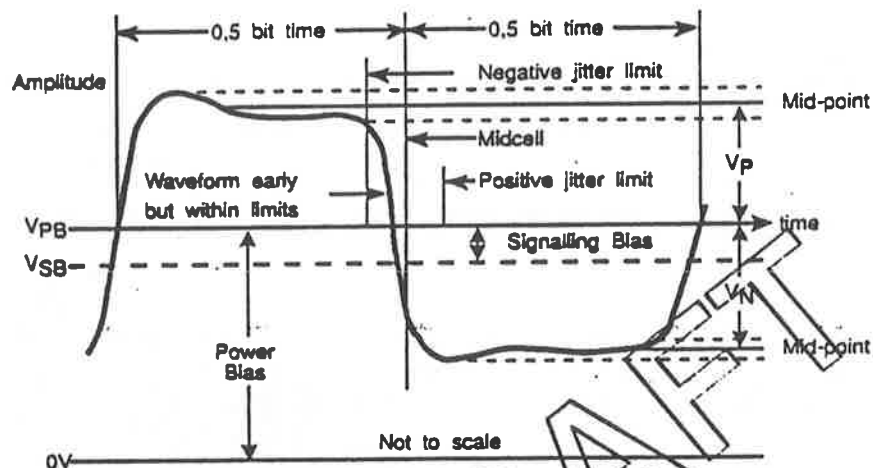


Figure 20 — Received bit cell jitter

12.5 Jabber inhibit

The MAU shall contain a self-interrupt capability to inhibit transmitted signals from reaching the medium. Hardware within the MAU (with no external message other than the detection of output signals or leakage via the transmit function) shall provide a window of between 5 ms and 15 ms during which time a normal frame may be transmitted. If the frame length exceeds this duration, the jabber inhibit function shall inhibit further output signals from reaching the medium and shall disable echo on the RxS line (see 10.2.2) to indicate jabber detection to the MDS.

The MAU shall reset the self-interrupt function after a period of 500 ms \pm 50%.

NOTE — This inhibits bus traffic for no more than 3% (= 1/32) of the available time.

12.6 Power distribution

NOTES

- 1 A device can optionally receive power via the signal conductors or be separately powered.
- 2 A separately powered device can be connected to a powered Field Bus.
- 3 For ease of reference, the requirements of 12.6 are summarized in tables 16 and 17.

Table 16 — Network powered device characteristics for the 1,0 Mbit/s voltage-mode MAU

Network powered device characteristics	Limits for 1,0 Mbit/s voltage mode
Operating voltage	9,0 to 32,0 V d.c.
Minimum withstand voltage, either polarity, for no damage	35 V
Maximum rate of change of quiescent current (non-transmitting)	0,05 mA/ μ s

Table 17 — Network power supply requirements for the 1,0 Mbit/s voltage-mode MAU

Network power supply requirements	Limits for 1,0 Mbit/s voltage mode
Output voltage	≤ 32 V d.c.
Output ripple and noise	See figure 21
Output impedance, measured over the frequency range $0,25 f_r$ to $1,25 f_r$	≥ 8 k Ω

12.6.1 Supply voltage

A Field Bus device which includes a 1,0 Mbit/s voltage-mode MAU shall be capable of operating within a voltage range of 9 V to 32 V d.c. between the two conductors including ripple. The device shall withstand a minimum voltage of ± 35 V d.c. without damage.

A Field Bus device which includes a 1,0 Mbit/s voltage-mode MAU shall conform to the requirements of this part of this International Standard when powered by a supply with the following specifications:

- a) The output voltage of the power supply shall be 32 V d.c. maximum including ripple;

NOTE 1 — The voltage of the power supply added to the open circuit transmitter output voltage should be less than the limit specified by the local regulatory agency for the particular implementation.

- b) The output impedance of the power supply shall be ≥ 8 k Ω over the frequency range $0,25 f_r$ to $1,25 f_r$ (250 kHz to 1,25 MHz);

- c) The breakdown requirements of the isolation of the signal circuit and the power distribution circuit from ground and from each other shall be in accordance with IEC 65A (Central Office) 22, Table 17.

NOTE 2 — For a device which is powered from a supply with rated voltage ≤ 50 V d.c. or r.m.s., the equivalent test voltages at sea level are 444 V r.m.s., 635 V d.c. and 635 V peak impulse test. For a device which is powered from a supply with rated voltage between 150 and 300 V r.m.s., the equivalent test voltages at sea level are 2 260 V r.m.s., 3 175 V d.c. and 3 175 V peak impulse test.

12.6.2 Powered via signal conductors

A Field Bus device which includes a 1,0 Mbit/s voltage-mode MAU and is powered via the signal conductors shall be required to conform to the requirements of this part of this International Standard when operating with maximum levels of power supply ripple and noise as follows:

- a) 30 mV peak to peak over the frequency range $0,25 f_r$ to $1,25 f_r$ (250 kHz to 1,25 MHz);
- b) 2 V peak to peak over the frequency range 47 Hz to 63 Hz;
- c) 300 mV peak to peak at frequencies greater than $12,5 f_r$, up to a maximum of 25 MHz;
- d) levels at intermediate frequencies generally in accordance with figure 21.

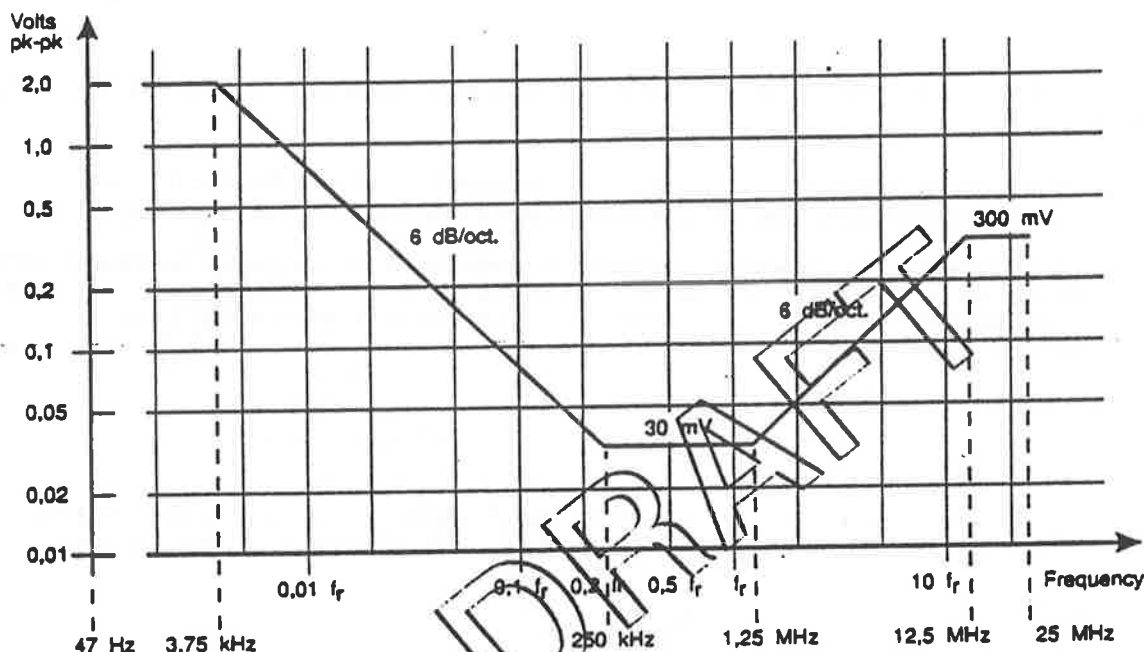


Figure 21 — Power supply ripple and noise

A Field Bus device which includes a 1,0 Mbit/s voltage-mode MAU and is powered via the signal conductors shall have a maximum rate of change of quiescent current in the non-transmitting condition of 0,05 mA/μs.

NOTE — This requirement limits the effect of power transients on the signals.

12.6.3 Powered separately from signal conductors

NOTE — Power distribution to non-bus powered Field Bus devices is by separate conductors feeding local power supplies or regulators. These conductors can be in a separate cable or in the same cable as the signal conductors.

A separately powered Field Bus device which includes a 1,0 Mbit/s voltage-mode MAU shall draw no more than 100 μA direct current from the signal conductors, nor shall it supply more than 100 μA direct current to the signal conductors when not transmitting.

12.6.4 Electrical Isolation

All Field Bus devices which use wire medium, whether separately powered or powered via the signal conductors, shall provide low frequency isolation between ground and the Field Bus trunk cable.

NOTE 1 — This may be by isolation of the entire device from ground or by use of a transformer, opto-coupler or some other isolating component between trunk cable and device.

A combined power supply and communication element shall not require electrical isolation.

The isolation impedance measured between the shield of the Field Bus cable and the Field Bus device ground shall be greater than 250 kΩ at all frequencies below 63 Hz.

The isolation shall be by-passed at high frequencies by capacitance, such that the impedance measured between the shield of the Field Bus cable and the Field Bus device ground shall be less than 15 Ω between 3-30 MHz.

NOTE 2 — The capacitance between ground and trunk cable shield necessary to meet both these requirements can be any value between 3,5 nF and 10,6 nF.

The maximum unbalanced capacitance to ground from either input terminal of a device shall not exceed 250 pF.

The breakdown requirements of the isolation of the signal circuit and the power distribution circuit from ground and from each other shall be in accordance with IEC 65A (Central Office) 22, Table 17.

NOTE 3 — For a device which is powered from a supply with rated voltage ≤ 50 V d.c. or r.m.s., the equivalent test voltages at sea level are 444 V r.m.s., 635 V d.c. and 635 V peak impulse test. For a device which is powered from a supply with rated voltage between 150 and 300 V r.m.s., the equivalent test voltages at sea level are 2 260 V r.m.s., 3 175 V d.c. and 3 175 V peak impulse test.

12.7 Medium specification

12.7.1 Connector

Cable connectors, if used, shall be to the IEC Field Bus standard (see annex B). Field termination techniques such as screw or blade terminals and permanent termination may also be used.

12.7.2 Cable

The cable used for testing Field Bus devices with a 1,0 Mbit/s voltage-mode MAU for conformance to the requirements of this part of this International Standard shall be a single twisted pair cable with overall shield meeting the following minimum requirements at 25°C:

- a) Z_0 at $0,25 f_r$ (250 kHz) = $150 \Omega \pm 10\%$;
- b) Z_0 at $1,25 f_r$ (1,25 MHz) = $150 \Omega \pm 10\%$;
- c) maximum attenuation at $0,25 f_r$ (250 kHz) = 6,5 dB/km;
- d) maximum attenuation at $1,25 f_r$ (1,25 MHz) = 13 dB/km;
- e) maximum capacitive unbalance to shield = 1,5 nF/km
- f) maximum d.c. resistance (per conductor) = 57,1 Ω /km;
- g) conductor cross sectional area (wire size) = nominal 0,33 mm² (#22 AWG);
- h) minimum resistance between either conductor and shield = 16 G Ω km;
- i) minimum shield coverage shall be 95%.

NOTE — Other types of cable may be used, other than for conformance testing. Cables with improved specifications may enable increased trunk length and/or superior interference immunity. Conversely, cables with inferior specifications may be used subject to length limitations for both trunk and spurs plus possible non-conformance to the RF/EMI susceptibility requirements.

12.7.3 Coupler

The coupler shall provide one or several point(s) of connection to the trunk. It may be integrated in a Field Bus device, in which case there is no spur. Otherwise it has at least three access points as shown in figure 22; one for the spur and one for each side of the trunk.

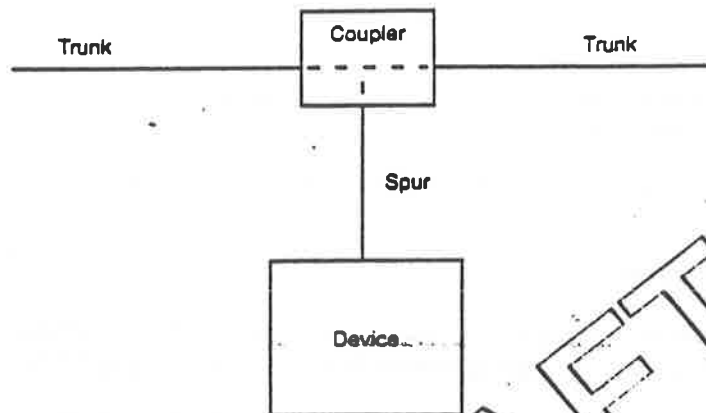


Figure 22 — Field Bus coupler

A passive coupler may contain any or all of the optional elements as described below:

- a) a transformer, to provide galvanic isolation and impedance transformation between trunk and spur;
- b) connectors, to provide easy connection to spur and/or trunk;
- c) protection resistors, as shown in figure 23, to protect bus traffic between other stations from the effects of a short circuit spur for separately powered device spurs.

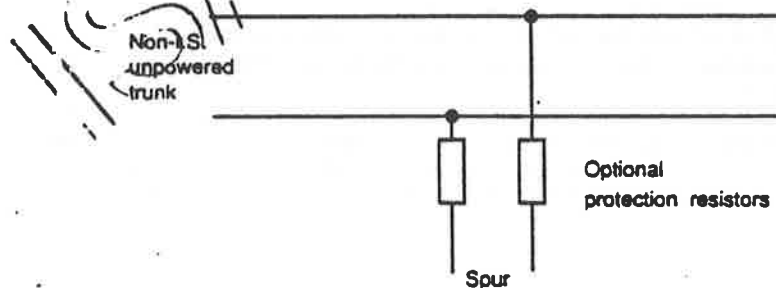


Figure 23 — Protection resistors

Active couplers, which require external power supplies, contain components for signal amplification and re-transmission. The transmit level and timing requirements shall be according to 12.3.

12.7.4 Splices

NOTE — A splice is any part of the network in which the characteristic impedance of the network cable is not preserved. This is possibly due to separation of the cable conductors, removal of the cable shield, change of wire gauge or type, connection to spurs, attachment to terminal strips, etc. A practical definition of a splice is therefore any part of the network that is not a continuous length of the specified medium.

The continuity of all conductors of the cable shall be maintained in a splice.

12.7.5 Terminator

A terminator shall be located at both ends of the trunk cable, connected from one signal conductor to the other. No connection shall be made between terminator and cable shield.

For test purposes, using the cable specified in 12.7.2, the terminator shall have an impedance value of $150 \Omega \pm 2\%$ over the frequency range $0,25 f_r$ to $1,25 f_r$ (250 kHz to 1,25 MHz).

NOTE — In practical implementations this value would be selected to be approximately equal to the average cable characteristic impedance value at the relevant frequencies to minimize transmission line reflections.

The direct current leakage through the terminator shall not exceed 100 μ A. The terminator shall be non-polarized.

12.7.6 Shielding rules

For full conformance to the noise immunity requirements of 12.4 it is necessary to ensure the integrity of shielding throughout the cabling, connectors and couplers by the following means:

- a) the coverage of the cable shield shall be greater than 95% of the full cable length;
- b) shielding shall completely cover the electrical circuits in connectors, couplers, and splices.

NOTE — Deviation from these shielding rules may degrade noise immunity.

12.7.7 Grounding rules

NOTE 1 — Grounding means permanently connected to earth through a sufficiently low impedance and with sufficient current carrying capability to prevent voltage build up which might result in undue hazard to connected equipment or persons. Zero volts (common) lines may be connected to ground where they are galvanically isolated from the Field Bus trunk.

Field Bus devices shall be required to function to the requirements of this part of this International Standard with the mid-point of one terminator or one inductive coupler connected directly to ground.

Field Bus devices shall not connect either conductor of the twisted pair to ground at any point in the network. Signals shall be applied and preserved differentially throughout the network.

NOTE 2 — It is standard practice for the shield of the Field Bus trunk cable (if applicable) to be effectively grounded at one point along the length of the cable. For this reason Field Bus devices should allow d.c. isolation of the cable shield from ground. For bus powered systems the grounding of the shield and balanced signal conductors would be close to the power supply unit. Capacitive coupling between the shield or the balanced signal conductors and device local ground for EMI control is permitted.

13 Medium Attachment Unit (MAU) : Current mode, wire medium

NOTES

- 1 The 1,0 Mbit/s current-mode MAU simultaneously provides access to a communication network and to a power distribution network. Devices attached to the network communicate via the medium and may or may not be powered from it. Power is distributed as a constant a.c. current. The communications signals are superimposed on the a.c. power.
- 2 The network medium consists of shielded twisted-pair cable.
- 3 Trapezoidal waveforms are used to reduce electromagnetic emissions and signal distortion.
- 4 In Intrinsically Safe applications, available power may limit the number of devices.
- 5 The devices are connected in series on the bus whereas in the voltage-mode variants the devices are in parallel.

13.1 Transmitted bit rate

The current-mode transmitted bit rate shall be $1,0 \text{ Mbit/s} \pm 0,01\%$, averaged over a frame having a minimum length of 16 octets. The instantaneous bit time shall be $1,0 \mu\text{s} \pm 0,025 \mu\text{s}$.

13.7.7 Grounding rules

NOTE 1 — Grounding means permanently connected to earth through a sufficiently low impedance and with sufficient current carrying capability to prevent voltage build up which might result in undue hazard to connected equipment or persons. Zero volts (common) lines may be connected to ground where they are galvanically isolated from the Field Bus trunk.

Field Bus devices shall not connect either conductor of the twisted pair to ground at any point in the network. Signals shall be applied and preserved differentially throughout the network.

NOTE 2 — It is standard practice for the shield of the Field Bus trunk cable (if applicable) to be effectively grounded at one point along the length of the cable. For this reason Field Bus devices should allow d.c. isolation of the cable shield from ground. For bus powered systems the grounding of the shield and balanced signal conductors would be close to the power supply unit. For I.S. systems the grounding would be at the safety barrier earth connection. Capacitive coupling between the shield or the balanced signal conductors and device local ground for EMI control is permitted subject to I.S. requirements.

14 Medium Attachment Unit (MAU) : 2,5 Mbit/s, voltage mode, wire medium

NOTES

- 1 The 2,5 Mbit/s voltage-mode MAU requirements are not specifically intended to facilitate the options of power distribution via the signal conductors and suitability for Intrinsic Safety certification. If bus powered, power is distributed as direct voltage and current, and communications signals are superimposed on the d.c. power.
- 2 The network medium consists of shielded twisted-pair cable. Independent of topology, all attached devices, other than possibly the transmitting device, are high impedance to prevent significant network loading. Trapezoidal waveforms are used to reduce electromagnetic emissions and signal distortion.
- 3 A linear bus topology is supported. A network contains one trunk cable, terminated at both ends.

14.1 Transmitted bit rate

The transmitted bit rate shall be 2,5 Mbit/s \pm 0,01%, averaged over a frame having a minimum length of 16 octets. The instantaneous bit time shall be 0,4 μ s \pm 0,010 μ s.

14.2 Network specifications

NOTE — A 2,5 Mbit/s voltage-mode MAU operates in a network composed of the following components:

- a) Cable;
- b) Terminators;
- c) Couplers;
- d) Devices (containing at least one communication element).

A wire network in 2,5 Mbit/s voltage mode may additionally include the following components:

- e) Connectors;
- f) Power supplies;
- g) Devices which include power supplies.

14.2.1 Topologies

A wire MAU shall operate in a network with a linear bus topology, consisting of a trunk, terminated at each end as specified in 14.7.5, to which communication elements are connected via couplers. Each communication element shall be connected in parallel with the trunk cable.

NOTES

- 1 The coupler and communication element are generally integrated in one device.

- 2 Active repeaters may be used to establish branches or to extend the length of the trunk beyond that of a single segment as permitted by the network configuration rules. Branches must be considered as segments.

14.2.2 Network configuration rules

A 2,5 Mbit/s voltage-mode MAU shall be required to conform to the requirements of this part of this International Standard when used in a network which complies with these rules.

Rule 1: One Field Bus shall be capable of communication between two and 32 devices, all operating at the same bit rate.

NOTE 1 — Rule 1 does not preclude the use of more than the specified number of devices in an installed system.

Rule 2: A fully loaded (maximum number of connected devices) 2,5 Mbit/s voltage-mode Field Bus segment shall have a total cable length, including branches, between any two devices, of up to 500 m.

NOTE 2 — 500 m maximum cable length is the requirement for conformance to this standard but this does not preclude the use of longer lengths in an installed system.

Rule 3: The total number of waveform regenerations by repeaters and active couplers between any two devices shall not exceed four.

Rule 4: The maximum propagation delay between any two devices shall not exceed 40 nominal bit times.

NOTE 3 — For efficiency of the network, that part of the turnaround time of any device on the network caused by a PhE between the end of a received frame and the beginning of the transmitted frame containing an associated immediate response should not exceed 5 bit times, no more than 2 bit times of which should be due to the MAU. As it is not mandatory to expose the DLL-PhL interface or the MDS-MAU interface, that part of the turn-around time of a Field Bus device caused by the PhL or the MAU cannot be specified or conformance tested.

Rule 5: The Field Bus shall be capable of continued operation while a device is being connected or disconnected. Data errors induced during connection or disconnection shall be detected.

Rule 6: For a 2,5 Mbit/s wire Field Bus which is not powered via the signal conductors, a single failure in any one communication element (including a short circuit but excluding jabber) shall not interfere with transactions between other communication elements for more than 1 ms.

Rule 7: In polarity sensitive systems the medium twisted pairs shall have distinctly marked conductors which uniquely identify individual conductors. The polarization shall be maintained at all connection points.

Rule 8: The degradation of the electrical characteristics of the signal, between any two devices, due to attenuation, attenuation distortion and mismatching shall be limited to the values indicated below.

- a) Signal attenuation: The configuration of the bus (trunk length, number of devices, and possible matching devices) shall be such that the attenuation between any two devices at the frequency corresponding to the bit rate shall not exceed 18 dB;
- b) Attenuation distortion: The configuration of the bus (trunk length and number of devices) shall be such that between any two devices:

$$[\text{Attenuation}(1,25 f_T) - \text{Attenuation}(0,25 f_T)] \leq 10 \text{ dB}$$

$$\text{Attenuation}(1,25 f_T) \geq \text{Attenuation}(0,25 f_T)$$

where f_r is the frequency corresponding to the bit rate. Attenuation shall be monotonic for all frequencies from $0,25 f_r$ to $1,25 f_r$ (625 kHz to 3,125 MHz);

c) Mismatching Distortion: Mismatching (due to any effect) on the bus shall be such that, at any point along the trunk, in the frequency band $0,25 f_r$ to $1,25 f_r$ (625 kHz to 3,125 MHz):

$$|(Z - Z_0) / (Z + Z_0)| \leq 0,2$$

where Z_0 is the characteristic impedance of the trunk cable and Z is the parallel combination of Z_0 and the load impedance at the coupler.

NOTE 4 — Rule 8 minimizes restrictions on trunk length, number of devices etc. by specifying only the transmission limitations imposed by combinations of these factors. Different combinations may be used depending on the needs of the application.

NOTE 5 — The main cause of a large mismatch is the concentration of several couplers on a short length of the trunk.

If the distance between two consecutive couplers is less than 2 m the propagation delay between them is smaller than 10 ns ($1/8$ of the maximum rise or fall times specified for the transmit signal) and the concentration appears as a single mismatched element inducing large reflections of the signal transitions.

A concentration of couplers where the distance between two consecutive couplers is less than 2 m is defined as a cluster.

In order to comply with the Rule 8c using devices with an input impedance of minimum value (8 k Ω) and zero length spurs, it is recommended that a cluster would not include more than four couplers.

Using devices with an input impedance significantly higher than the minimum value would allow clusters with more couplers. Using non-zero length spurs could require clusters to have fewer than four couplers.

NOTE 6 — It is possible to reduce the mismatching due to a cluster by the following means:

- using active multiport couplers;
- inserting matching devices (passive attenuators) each side of the cluster, under the condition that the Rule 8b is satisfied.

Rule 9: The following rules shall apply to systems implemented with redundant media:

- a) each channel (cable) shall comply with the network configuration rules;
- b) there shall not be a non-redundant segment between two redundant segments;
- c) repeaters shall also be redundant;
- d) if the system is configured (by Station Management) to transmit on more than one channel simultaneously then the propagation time difference between any two devices on any two channels shall not exceed five bit times;
- e) channel numbers shall be maintained throughout the Field Bus, i.e. channels 1,2,3... from Station Management shall always connect to physical channels 1,2,3...

14.2.3 Power distribution rules for network configuration

The cable shield shall not be used as a power conductor.

14.3 Transmit circuit specification for 2,5 Mbit/s voltage-mode MAU

NOTE — For ease of reference, the requirements of 14.3 are summarized in tables 22 and 23.

Table 22 — Transmit level specification summary for 2,5 Mbit/s voltage-mode MAU

Transmit level characteristics, values referred to trunk (but measured using test load as shown in figure 30)	Limits for 2,5 Mbit/s voltage mode
Output level (peak-to-peak, see figure 31) With test load (non-standard for this test)	5,5 V to 9,0 V 50 $\Omega \pm 1\%$
Maximum positive and negative amplitude difference (signalling bias) as shown in figure 32	$\pm 0,35$ V
Output Level; open circuit, (peak-to-peak)	$\pm 39,0$ V
Maximum output signal distortion; i.e., overvoltage, ringing and droop (See figure 31)	$\pm 10\%$
Quiescent transmitter output; i.e. transmitter noise (measured over the frequency band 1 kHz to 10 MHz)	≤ 10 mV (r.m.s.)

Table 23 — Transmit timing specification summary for 2,5 Mbit/s voltage-mode MAU

Transmit timing characteristics, values referred to trunk (but measured using test load as shown in figure 30)	Limits for 2,5 Mbit/s voltage mode
Transmitted bit rate	2,5 Mbit/s $\pm 0,01\%$
Instantaneous bit time	0,4 μ s $\pm 0,010$ μ s
Rise and fall times (10% to 90% of pk-pk signal, see figure 31)	$\leq 0,2$ nominal bit time
Slew rate (at any point from 10% to 90% of pk-pk signal)	≤ 250 V / μ s
Maximum transmitted bit cell jitter (zero-crossing point deviation, see figure 32)	$\pm 0,020$ nominal bit time
Transmit enable/disable time (i.e. time during which the output waveform may not meet the transmit requirements)	$\leq 2,0$ nominal bit times

14.3.1 Test Configuration

Figure 30 shows the configuration which shall be used for testing.

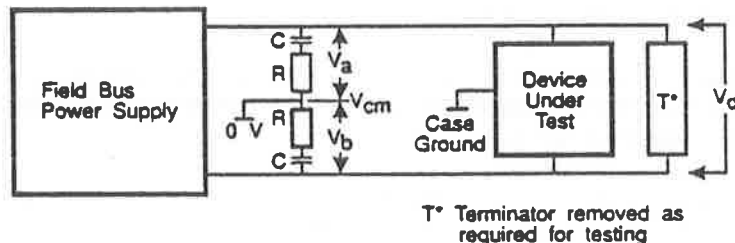


Figure 30 — Transmit circuit test configuration

Differential signal voltage: $V_d = V_a - V_b$

Test load resistance $R = 75 \Omega$ (0,5 cable Z_0) and $C = 0,15 \mu$ F except where otherwise stated in a specific requirement.

14.3.2 Output level requirements

NOTE — Figure 31 shows an example of the a.c. component of one cycle of a Field Bus waveform, illustrating some key items from the transmit circuit specification. Only signal voltages are shown; this diagram takes no account of power supply voltages.

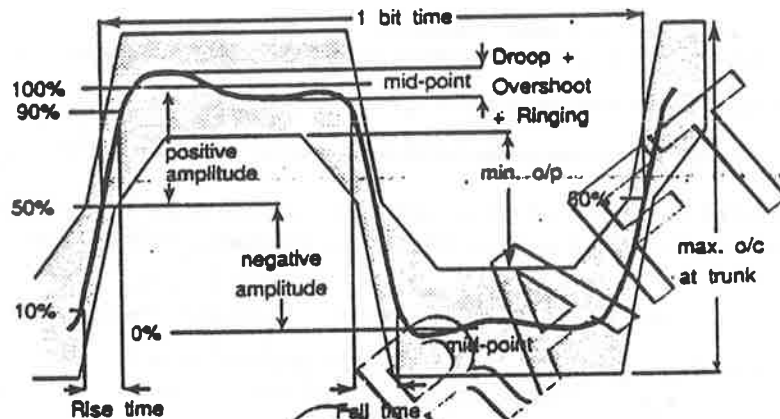


Figure 31 — Output waveform

A 2,5 Mbit/s voltage-mode MAU transmit circuit shall conform to the following output level requirements, all amplitudes being measured at the estimated mid-point between any peaks or troughs in the top and bottom of the waveform ("mid-point" in figure 31):

- a) the output voltage across the test load after transformer step up/down (if applicable) shall be between 5,5 V and 9,0 V peak-to-peak for all load resistances from $50 \Omega \pm 1\%$ to $75 \Omega \pm 1\%$ ("min o/p" in figure 31);
- b) the output voltage at the trunk, or at the transmit terminals, with any load including an open circuit shall not exceed 30,0 V peak-to-peak ("max o/c at trunk" in figure 31). For test purposes open circuit shall be defined as a load of 100 k Ω resistance in parallel with 15 pF capacitance;
- c) during transmission a device shall not suffer permanent failure when a load resistance of $\leq 1 \Omega$ is applied for 1 second;
- d) the difference between positive amplitude and negative amplitude, measured as shown in figure 32, shall not exceed $\pm 0,35$ V peak;
- e) the output noise from a 2,5 Mbit/s voltage-mode MAU which is receiving or not powered shall not exceed 10 mV r.m.s., measured differentially over the frequency band 1 kHz to 10 MHz, referred to the trunk;
- f) the differential voltage across the test load shall be such that the voltage monotonically changes between 10% and 90% of peak-to-peak value. Thereafter, the signal voltage shall not vary more than $\pm 10\%$ of peak-to-peak value until next transition occurs. This permitted variation shall include all forms of output signal distortion, i.e. overvoltage, ringing and droop.

14.3.3 Output timing requirements

A 2,5 Mbit/s voltage-mode MAU transmit circuit shall conform to the following output timing requirements:

a) rise and fall times, measured from 10% to 90% of the peak-to-peak signal amplitude shall not exceed 0,2 nominal bit time (see figure 31);

b) slew rate shall not exceed 250 V/μs measured at any point in the range 10% to 90% of the peak-to-peak signal amplitude (see figure 31);

NOTE — Requirements a) and b) produce a trapezoidal waveform at the transmit circuit output. Requirement b) limits the level of interference emissions which may be coupled to adjacent circuits etc. Requirement b) is calculated from the formula:

$$\text{Max. slew rate} = 3 \times \text{Min. slew rate} = 3 \times 0,8 V_0 / 0,2 T = 12 \times V_0 / T$$

where V_0 is the maximum pk-pk output voltage (9,0 V), and T is the nominal bit time (0,4 μs).

c) transmitted bit cell jitter shall not exceed $\pm 0,020$ nominal bit time from the ideal zero crossing point, measured with respect to the previous zero crossing (see figure 32);

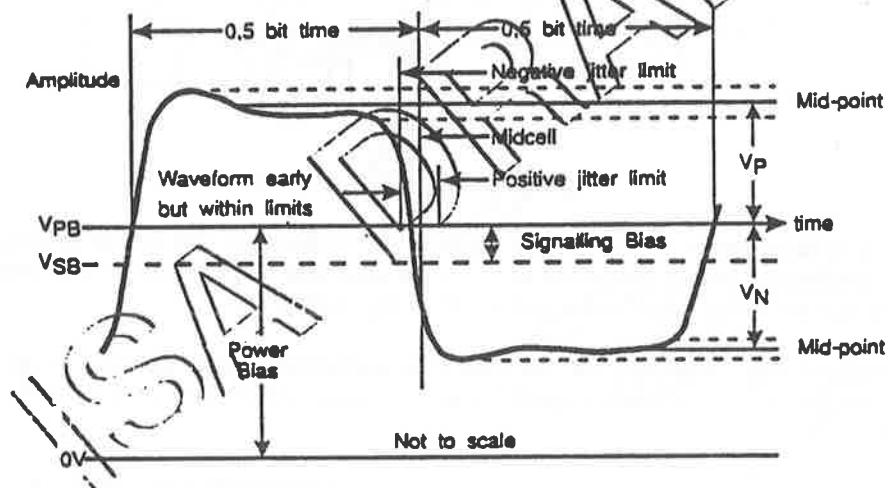


Figure 32 — Transmitted bit cell jitter (zero crossing point deviation)

d) the transmit circuit shall turn on, i.e. the signal shall rise from below the transmit circuit maximum output noise level as specified in 14.3.2 (e) to full output level, in less than 2 nominal bit times. The waveform corresponding to the third and later bit times shall be as specified by other parts of 14.3;

e) the transmit circuit shall turn off, i.e. the signal shall fall from full output level to below the transmit circuit maximum output noise level as specified in 14.3.2 (e), in less than 2 nominal bit times. The time for the transmit circuit to return to its off state impedance shall not exceed 4 nominal bit times. For the purposes of testing, this requirement shall be met with the transmit circuit test configuration of 14.3.1 with the equivalent capacitance of a maximum length cable across the DUT terminals.

NOTE — This requirement is to ensure that the transition of the transmit circuit from active to passive leaves the line capacitance fully discharged.

14.4 Receive circuit specification for 2,5 Mbit/s voltage-mode MAU

NOTE — For ease of reference, the requirements of 14.4 are summarized in table 24.

Table 24 — Receive circuit specification summary for 2,5 Mbit/s voltage-mode MAU

Receive circuit characteristics (values referred to trunk)	Limits for 2,5 Mbit/s voltage mode
Input impedance, measured over the frequency range $0,25 f_r$ to $1,25 f_r$	$\geq 8 \text{ k}\Omega$
Sensitivity; min. pk-pk signal required to be accepted (see figure 33)	700 mV
Noise rejection; max. pk-pk noise required to be rejected (see figure 33)	280 mV
Maximum received bit cell jitter (zero-crossing point deviation, see figure 34)	$\pm 0,10$ nominal bit time

14.4.1 Input impedance

The differential input impedance of a 2,5 Mbit/s voltage-mode MAU receive circuit shall be no less than $8 \text{ k}\Omega$ over the frequency range $0,25 f_r$ to $1,25 f_r$ (625 kHz to 3,125 MHz). This requirement shall be met in the power-off and power-on (not transmitting) states and in transition between these states. This impedance shall be measured at the communication element terminals using a sine wave with a signal amplitude greater than the receiver sensitivity threshold and lower than 9,0 V peak-to-peak.

NOTE — The requirement for $\geq 8 \text{ k}\Omega$ input impedance during power-up and power-down may be met by automatic disabling of the transmitter during these periods.

14.4.2 Receiver sensitivity and noise rejection

A 2,5 Mbit/s voltage-mode MAU receive circuit shall be capable of accepting an input signal of amplitude no less than 700 mV peak-to-peak, including overvoltage and oscillation (see "signal level" in figure 33 together with "positive amplitude" and "negative amplitude" in figure 31).

A 2,5 Mbit/s voltage-mode MAU receive circuit shall not respond to an input signal with a peak-to-peak amplitude which does not exceed 280 mV (see "noise rejection" in figure 33).

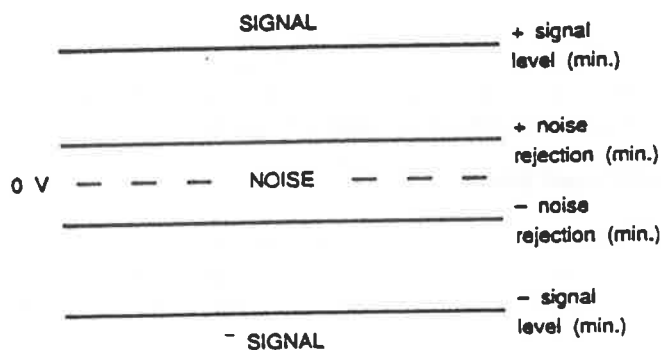


Figure 33 — Receiver sensitivity and noise rejection

14.4.3 Interference susceptibility and error rates

NOTE 1 — When the Field Bus is operating in a variety of standard noise environments the probability that an Application Layer User Data Unit contains an undetected error, due to operation of the conveying Physical and Data Link Layer entities, should be less than 1 in 10^{12} (1 error in 20 years at 1 600 messages/s). A communication element is regarded as conforming to this theoretical requirement when it meets the following interference susceptibility requirements. These are specified by a detected frame error rate which is derived by using a ratio of detected to undetected errors of 10^6 . This follows the IEEE 802 Functional Requirements Document Draft 5.9, sections 5.6.1 and 5.6.2 and should be readily achievable with a 16 bit Frame Check Sequence at the Data Link Layer.

A communication element which includes a 2,5 Mbit/s voltage-mode MAU, operating with frames containing 64 random user data bits, with maximum frame rate and with signals of 1,4 V pk-pk amplitude, shall produce no more than 3 detected frame errors in 3×10^6 frames during operation in the presence of common mode voltage or Gaussian noise as follows:

- a) a common mode sinusoidal signal of any frequency from 63 Hz to 5 MHz, with an amplitude of 4 V r.m.s. and from 47 Hz to 63 Hz with an amplitude of 250 V r.m.s.;
- b) a common mode d.c. signal of ± 10 V;
- c) ~~white Gaussian additive differential noise in the frequency band 2 kHz to 10 MHz, with a noise density of 20 μ V/Hz r.m.s.~~

NOTE 2 — The common mode voltage and Gaussian noise specifications are for receive circuit conformance testing with balanced loads and are not indicative of system installation practice.

A communication element which includes a 2,5 Mbit/s voltage-mode MAU, operating with frames containing 64 random user data bits, at an average of 1 600 messages per second, with signals of 1,4 V pk-pk amplitude, shall produce no more than 6 detected frame errors in 100 000 frames during operation in the presence of electromagnetic or electrical interference environments as follows:

- 1) 10 V/m electromagnetic field as specified in IEC 801.3 at severity level 3;
- 2) electrical fast transient as specified in IEC 801.4 at severity level 3.

The above error rate specification shall also be satisfied after but not during operation in the following noise environments:

- i) 8 kV electrostatic discharge to exposed metalwork as specified in IEC 801.2 at severity level 3. If the device suffers temporary loss of function or performance as a result of this test it shall recover from any such loss without operator intervention within 3 seconds after the end of the test;
- ii) high frequency disturbance tests as specified in IEC 255-4 Appendix E, Test voltage class III (2,5 kV and 1 kV peak values of first half-cycle in longitudinal and transverse mode respectively). If the device suffers temporary loss of function or performance as a result of this test it shall recover from any such loss without operator intervention within 3 seconds after the end of the test.

14.4.4 Received bit cell jitter

The receive circuit shall accept a Manchester encoded signal transmitted in accordance with 14.1 and 14.3. In addition, the receiver shall accept signals with the time variation between any two adjacent signal transition points (zero crossing) of no greater than $\pm 0,10$ nominal bit time. See figure 34.

NOTES

- 1 This does not preclude the use of receivers which perform better than this specification.
- 2 Depending on the symbol pattern, the nominal time between zero crossings may be one-half or one bit time.

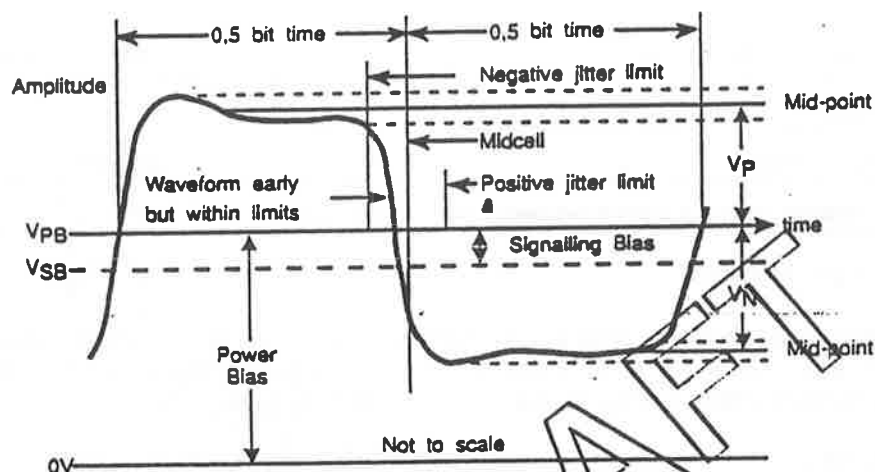


Figure 34 — Received bit cell jitter

14.5 Jabber inhibit

The MAU shall contain a self-interrupt capability to inhibit transmitted signals from reaching the medium. Hardware within the MAU (with no external message other than the detection of output signals or leakage via the transmit function) shall provide a window of between 2 ms and 6 ms during which time a normal frame may be transmitted. If the frame length exceeds this duration, the jabber inhibit function shall inhibit further output signals from reaching the medium and shall disable echo-on the RxS line (see 10.2.2) to indicate jabber detection to the MDS.

The MAU shall reset the self-interrupt function after a period of 200 ms \pm 50%.

NOTE — This inhibits bus traffic for no more than 3% ($\approx 1/32$) of the available time.

14.6 Power distribution

NOTES

- 1 A device can optionally receive power via the signal conductors or be separately powered.
- 2 A separately powered device can be connected to a powered Field Bus.
- 3 For ease of reference, the requirements of 14.6 are summarized in tables 25 and 26.

Table 25 — Network powered device characteristics for the 2,5 Mbit/s voltage-mode MAU

Network powered device characteristics	Limits for 2,5 Mbit/s voltage mode
Operating voltage	9,0 to 32,0 V d.c.
Minimum withstand voltage, either polarity, for no damage	35 V
Maximum rate of change of quiescent current (non-transmitting)	0,1 mA/ms

Table 26 — Network power supply requirements for the 2,5 Mbit/s voltage-mode MAU

Network power supply requirements	Limits for 2,5 Mbit/s voltage mode
Output voltage	≤ 32 V d.c.
Output ripple and noise	See figure 35
Output impedance, measured over the frequency range $0,25 f_r$ to $1,25 f_r$	≥ 8 k Ω

14.6.1 Supply voltage

A Field Bus device which includes a 2,5 Mbit/s voltage-mode MAU shall be capable of operating within a voltage range of 9 V to 32 V d.c. between the two conductors including ripple. The device shall withstand a minimum voltage of ± 35 V d.c. without damage.

A Field Bus device which includes a 2,5 Mbit/s voltage-mode MAU shall conform to the requirements of this part of this International Standard when powered by a supply with the following specifications:

- a) The output voltage of the power supply shall be 32 V d.c. maximum including ripple;

NOTE 1 — The voltage of the power supply added to the open circuit transmitter output voltage should be less than the limit specified by the local regulatory agency for the particular implementation.

- b) The output impedance of the power supply shall be ≥ 8 k Ω over the frequency range $0,25 f_r$ to $1,25 f_r$ (625 kHz to 3,125 MHz);

- c) The breakdown requirements of the isolation of the signal circuit and the power distribution circuit from ground and from each other shall be in accordance with IEC 65A (Central Office) 22, Table 17.

NOTE 2 — For a device which is powered from a supply with rated voltage ≤ 50 V d.c. or r.m.s., the equivalent test voltages at sea level are 444 V r.m.s., 635 V d.c. and 635 V peak impulse test. For a device which is powered from a supply with rated voltage between 150 and 300 V r.m.s., the equivalent test voltages at sea level are 2 260 V r.m.s., 3 175 V d.c. and 3 175 V peak impulse test.

14.6.2 Powered via signal conductors

A Field Bus device which includes a 2,5 Mbit/s voltage-mode MAU and is powered via the signal conductors shall be required to conform to the requirements of this part of this International Standard when operating with maximum levels of power supply ripple and noise as follows:

- a) 30 mV peak to peak over the frequency range $0,25 f_r$ to $1,25 f_r$ (625 kHz to 3,125 MHz);
- b) 2 V peak to peak over the frequency range 47 Hz to 63 Hz;
- c) 300 mV peak to peak at frequencies greater than $12,5 f_r$, up to a maximum of 50 MHz;
- d) levels at intermediate frequencies generally in accordance with figure 35.

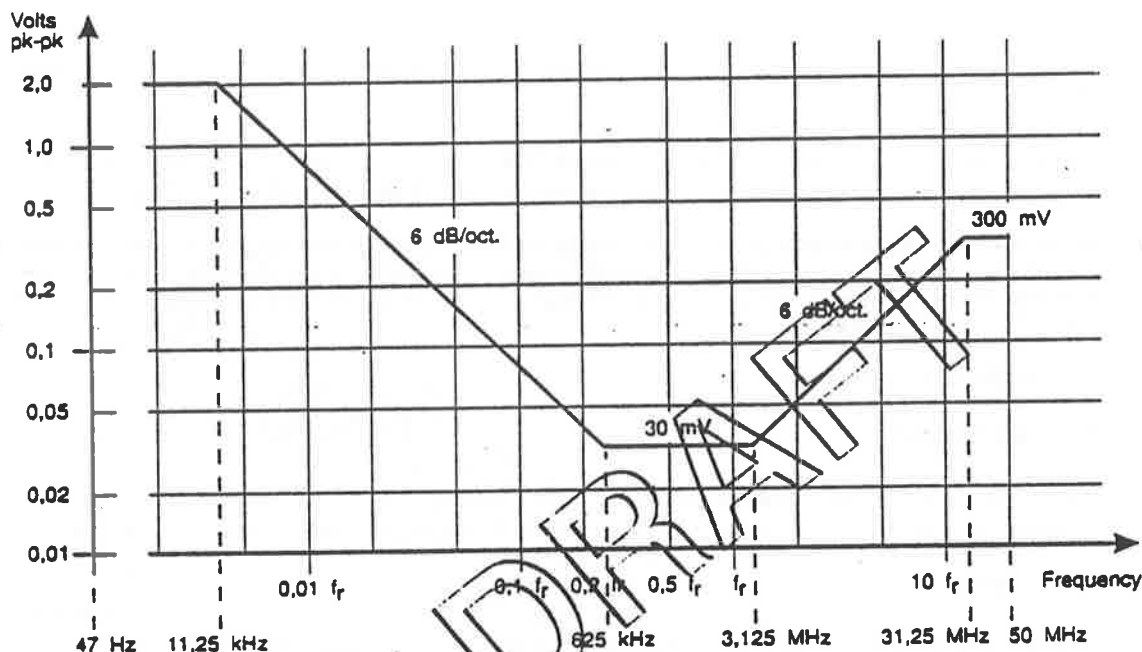


Figure 35 — Power supply ripple and noise

A Field Bus device which includes a 2.5 Mbit/s voltage-mode MAU and is powered via the signal conductors shall have a maximum rate of change of quiescent current in the non-transmitting condition of 0.1 mA/ms.

NOTE — This requirement limits the effect of power transients on the signals.

14.6.3 Powered separately from signal conductors

NOTE — Power distribution to non-bus powered Field Bus devices is by separate conductors feeding local power supplies or regulators. These conductors can be in a separate cable or in the same cable as the signal conductors.

A separately powered Field Bus device which includes a 2.5 Mbit/s voltage-mode MAU shall draw no more than 100 μ A direct current from the signal conductors, nor shall it supply more than 100 μ A direct current to the signal conductors when not transmitting.

14.6.4 Electrical Isolation

All Field Bus devices which use wire medium, whether separately powered or powered via the signal conductors, shall provide low frequency isolation between ground and the Field Bus trunk cable.

NOTE 1 — This may be by isolation of the entire device from ground or by use of a transformer, opto-coupler or some other isolating component between trunk cable and device.

A combined power supply and communication element shall not require electrical isolation.

The isolation impedance measured between the shield of the Field Bus cable and the Field Bus device ground shall be greater than 250 kΩ at all frequencies below 63 Hz.

The isolation shall be by-passed at high frequencies by capacitance, such that the impedance measured between the shield of the Field Bus cable and the Field Bus device ground shall be less than 15 Ω between 3–30 MHz.

NOTE 2 — The capacitance between ground and trunk cable shield necessary to meet both these requirements can be any value between 3,5 nF and 10,6 nF.

The maximum unbalanced capacitance to ground from either input terminal of a device shall not exceed 250 pF.

The breakdown requirements of the isolation of the signal circuit and the power distribution circuit from ground and from each other shall be in accordance with IEC 65A (Central Office) 22, Table 17.

NOTE 3 — For a device which is powered from a supply with rated voltage ≤ 50 V d.c. or r.m.s., the equivalent test voltages at sea level are 444 V r.m.s., 635 V d.c. and 635 V peak impulse test. For a device which is powered from a supply with rated voltage between 150 and 300 V r.m.s., the equivalent test voltages at sea level are 2 260 V r.m.s., 3 175 V d.c. and 3 175 V peak-impulse test.

14.7 Medium specification

14.7.1 Connector

Cable connectors, if used, shall be to the IEC Field Bus standard (see annex B). Field termination techniques such as screw or blade terminals and permanent termination may also be used.

14.7.2 Cable

The cable used for testing Field Bus devices with a 2,5 Mbit/s voltage-mode MAU for conformance to the requirements of this part of this International Standard be a single twisted pair cable with overall shield meeting the following minimum requirements at 25°C:

- a) Z_0 at $0,25 f_r$ (625 kHz) = $150 \Omega \pm 10\%$;
- b) Z_0 at $1,25 f_r$ (3,125 MHz) = $150 \Omega \pm 10\%$;
- c) maximum attenuation at $0,25 f_r$ (625 kHz) = 10 dB/km;
- d) maximum attenuation at $1,25 f_r$ (3,125 MHz) = 20 dB/km;
- e) maximum capacitive unbalance to shield = 1,5 nF/km
- f) maximum d.c. resistance (per conductor) = 57,1 Ω /km;
- g) conductor cross sectional area (wire size) = nominal 0,33 mm² (#22 AWG);
- h) minimum resistance between either conductor and shield = 16 G Ω km;
- i) minimum shield coverage shall be 95%.

NOTE — Other types of cable may be used, other than for conformance testing. Cables with improved specifications may enable increased trunk length and/or superior interference immunity. Conversely, cables with inferior specifications may be used subject to trunk length limitations plus possible non-conformance to the RF/EMI susceptibility requirements

14.7.3 Coupler

The coupler, as shown in figure 36, shall provide one or several point(s) of connection to the trunk. It is generally integrated in a Field Bus device.

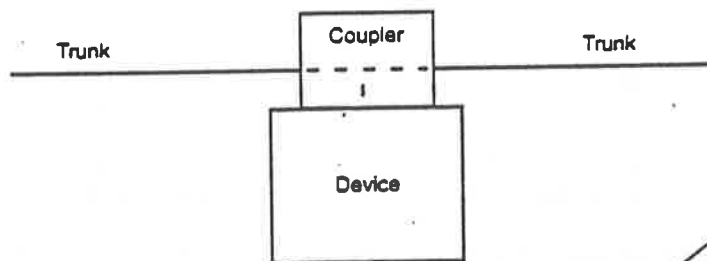


Figure 36 — Field Bus coupler

A passive coupler may contain any or all of the optional elements as described below:

- a) a transformer, to provide galvanic isolation and impedance transformation between trunk and device;
- b) connectors, to provide easy connection to trunk.

Active couplers, which require external power supplies, contain components for signal amplification and re-transmission. The transmit level and timing requirements shall be according to 14.3.

14.7.4 Splices

NOTE — A splice is any part of the network in which the characteristic impedance of the network cable is not preserved. This is possibly due to separation of the cable conductors, removal of the cable shield, change of wire gauge or type, attachment to terminal strips, etc. A practical definition of a splice is therefore any part of the network that is not a continuous length of the specified medium.

The continuity of all conductors of the cable shall be maintained in a splice.

14.7.5 Terminator

A terminator shall be located at both ends of the trunk cable, connected from one signal conductor to the other. No connection shall be made between terminator and cable shield.

For test purposes, using the cable specified in 14.7.2, the terminator shall have an impedance value of $150 \Omega \pm 2\%$ over the frequency range $0,25 f_r$ to $1,25 f_r$ (625 kHz to 3,125 MHz).

NOTE — In practical implementations this value would be selected to be approximately equal to the average cable characteristic impedance value at the relevant frequencies to minimize transmission line reflections.

The direct current leakage through the terminator shall not exceed 100 μ A. The terminator shall be non-polarized.

14.7.6 Shielding rules

For full conformance to the noise immunity requirements of 14.4 it is necessary to ensure the integrity of shielding throughout the cabling, connectors and couplers by the following means:

- a) the coverage of the cable shield shall be greater than 95% of the full cable length;
- b) shielding shall completely cover the electrical circuits in connectors, couplers, and splices.

NOTE — Deviation from these shielding rules may degrade noise immunity

14.7.7 Grounding rules

NOTE 1 — Grounding means permanently connected to earth through a sufficiently low impedance and with sufficient current carrying capability to prevent voltage build up which might result in undue hazard to connected equipment or persons. Zero volts (common) lines may be connected to ground where they are galvanically isolated from the Field Bus trunk.

Field Bus devices shall be required to function to the requirements of this part of this International Standard with the mid-point of one terminator or one inductive coupler connected directly to ground.

Field Bus devices shall not connect either conductor of the twisted pair to ground at any point in the network. Signals shall be applied and preserved differentially throughout the network.

NOTE 2 — It is standard practice for the shield of the Field Bus trunk cable (if applicable) to be effectively grounded at one point along the length of the cable. For this reason Field Bus devices should allow d.c. isolation of the cable shield from ground. For bus powered systems the grounding of the shield and balanced signal conductors would be close to the power supply unit. Capacitive coupling between the shield or the balanced signal conductors and device local ground for EMI control is permitted.

15 Medium Dependent Sublayer (MDS) : Optical

Under consideration

16 MDS – MAU Interface : Optical

Under consideration

17 Medium Attachment Unit (MAU) : Optical

Under consideration

18 Medium Dependent Sublayer (MDS) : Radio

Under consideration

19 MDS – MAU Interface : Radio

Under consideration

20 Medium Attachment Unit (MAU) : Radio

Under consideration

Annex A (Informative)

Bibliography and References

1. ISO/TR 8509, Open Systems Interconnection: service conventions (1986)
2. ISO/IEC/DIS 8886, Information Processing Systems - Data communication - Data link service definition for Open Systems Interconnection (1988)
3. IEEE Std 100-1984, Standard Dictionary of Electrical and Electronics Terms
4. IEC Multilingual Dictionary
5. CENELEC EN 50 020 1977, Intrinsically safe electrical apparatus

ISA DRAFT

Annex B (Normative)

IEC Field Bus connector specification

B.1 Internal connector for wire medium

A Field Bus connector which is inside the enclosure of the Field Bus device and therefore requires no protection against the electromagnetic and physical environment shall be specified as an internal connector. An internal connector shall meet the following functional requirements:

- Distinctly marked to avoid conductors being interchanged;
- Positive locking with a minimum of 50 Newtons extraction force locked;
- Field installation with hand tools shall be possible;
- The fixed (device) side shall be 4,8 mm x 0,8 mm male tabs with hole as shown in figure B.1, table B.1, and specified in IEC 760 (1989);
- Each conductor of the cable shall be terminated with a locking female connector with an insulating sleeve or housing;
- The female connector with insulating sleeve or housing shall fit through a 9,5 mm diameter hole.

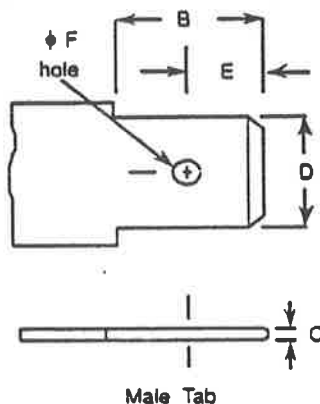


Figure B.1— Internal Field Bus connector

Table B.1 — Internal connector dimensions

4,8 mm (0,187 Inch) Male tab				
	millimetres		inches	
	max.	min.	max.	min.
B	6,5	6,2	0,256	0,244
C	0,84	0,77	0,033	0,030
D	4,9	4,7	0,193	0,185
E	3,4	3,0	0,134	0,117
ØF	1,5	1,3	0,060	0,060

B.2 External connectors for wire medium

A Field Bus connector which is outside the enclosure of the Field Bus device and therefore requires protection against the electromagnetic and physical environment shall be specified as an external connector.

Two external connectors are specified in accordance with the environment of the installation.

B.2.1 External connector for harsh industrial environments

An external connector for harsh industrial environments shall meet the following functional requirements:

- polarized to avoid conductors being interchanged, both mated and unmated;
- available with sealing to IEC 529 (1989) : IP 65 when mated or with protective caps fitted;
- the free (cable) side shall be available with a cable clamp which secures the cable but does not subject the cable conductors to damaging stress;
- the conductors shall be completely surrounded by a conductive shell which maintains the electrical continuity of the shield;
- the conductive shell of the free (cable) side shall be covered by insulating material;
- the conductive shell of the fixed (device) side shall be insulated from its mounting surface;
- the fixed (device) side shall provide a connection to the shield, other than the shell;
- the contacts shall accommodate wire sizes of 0,20 mm² (#24 AWG) to 0,64 mm² (#20 AWG);
- provided with positive locking to prevent disconnection by cable strain;
- provided with four pins (two signal pins and two power pins);
- available with crimped conductors;

- l) provided with male contacts on the fixed (device) side;
- m) a cable connector with male pins shall be available for in-line connection;
- n) dielectric strength from contacts to shell shall and from shell to ground be at least as high as specified under isolation for the appropriate MAU;
- o) contacts shall be assigned to functions as shown in table B.2 and figure B.2;
- p) connector dimensions (mating face) shall be as shown in figures B.3, B.4, and B.5.

Table B.2 — Contact assignments for the external connector for harsh industrial environments

Contact No.	Function
A	DATA + with the option of power +
B	DATA - with the option of power -
C	Reserved for option of power +
D	Reserved for option of power -

Connector views (from connection faces)


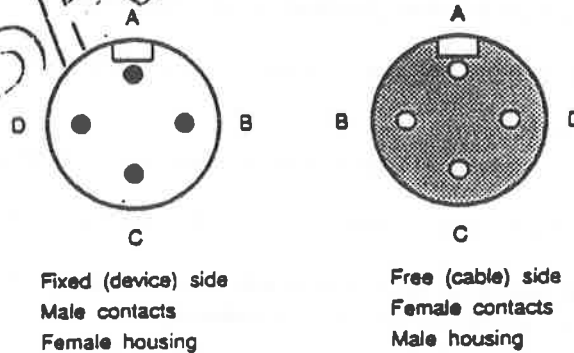


Figure B.2 — Contact designations for the external connector for harsh industrial environments

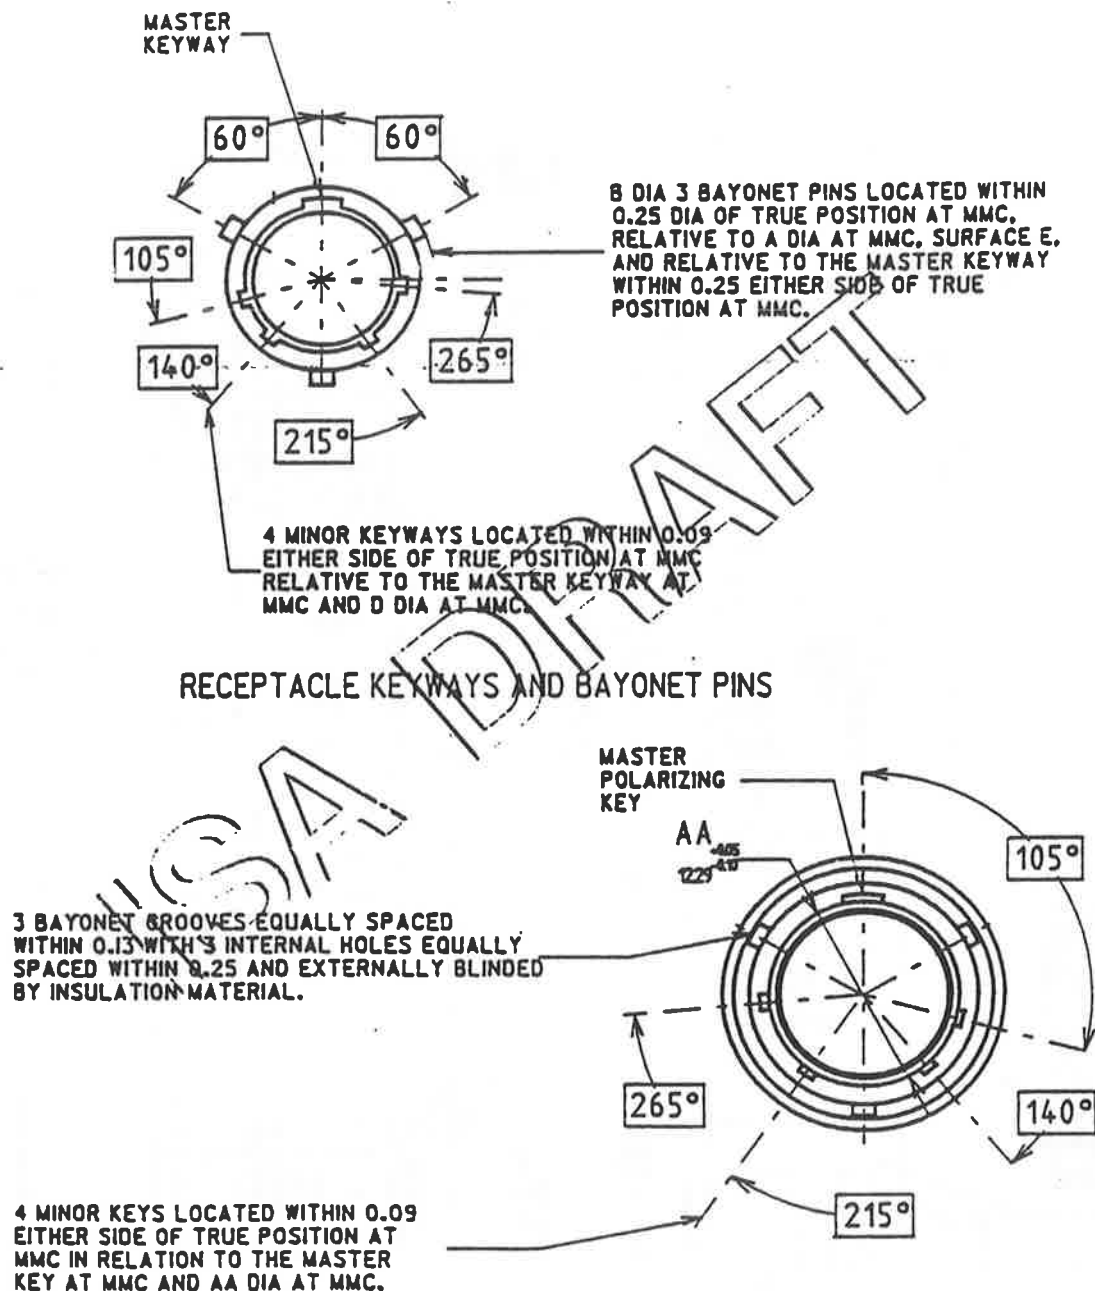



(a) Dimensions are in mm.

(b) MMC: maximum material condition.

Figure B.3 — External Field Bus connector keyways, keys, and bayonet pins and grooves

Figure B.4 — External Field Bus connector intermateability dimensions

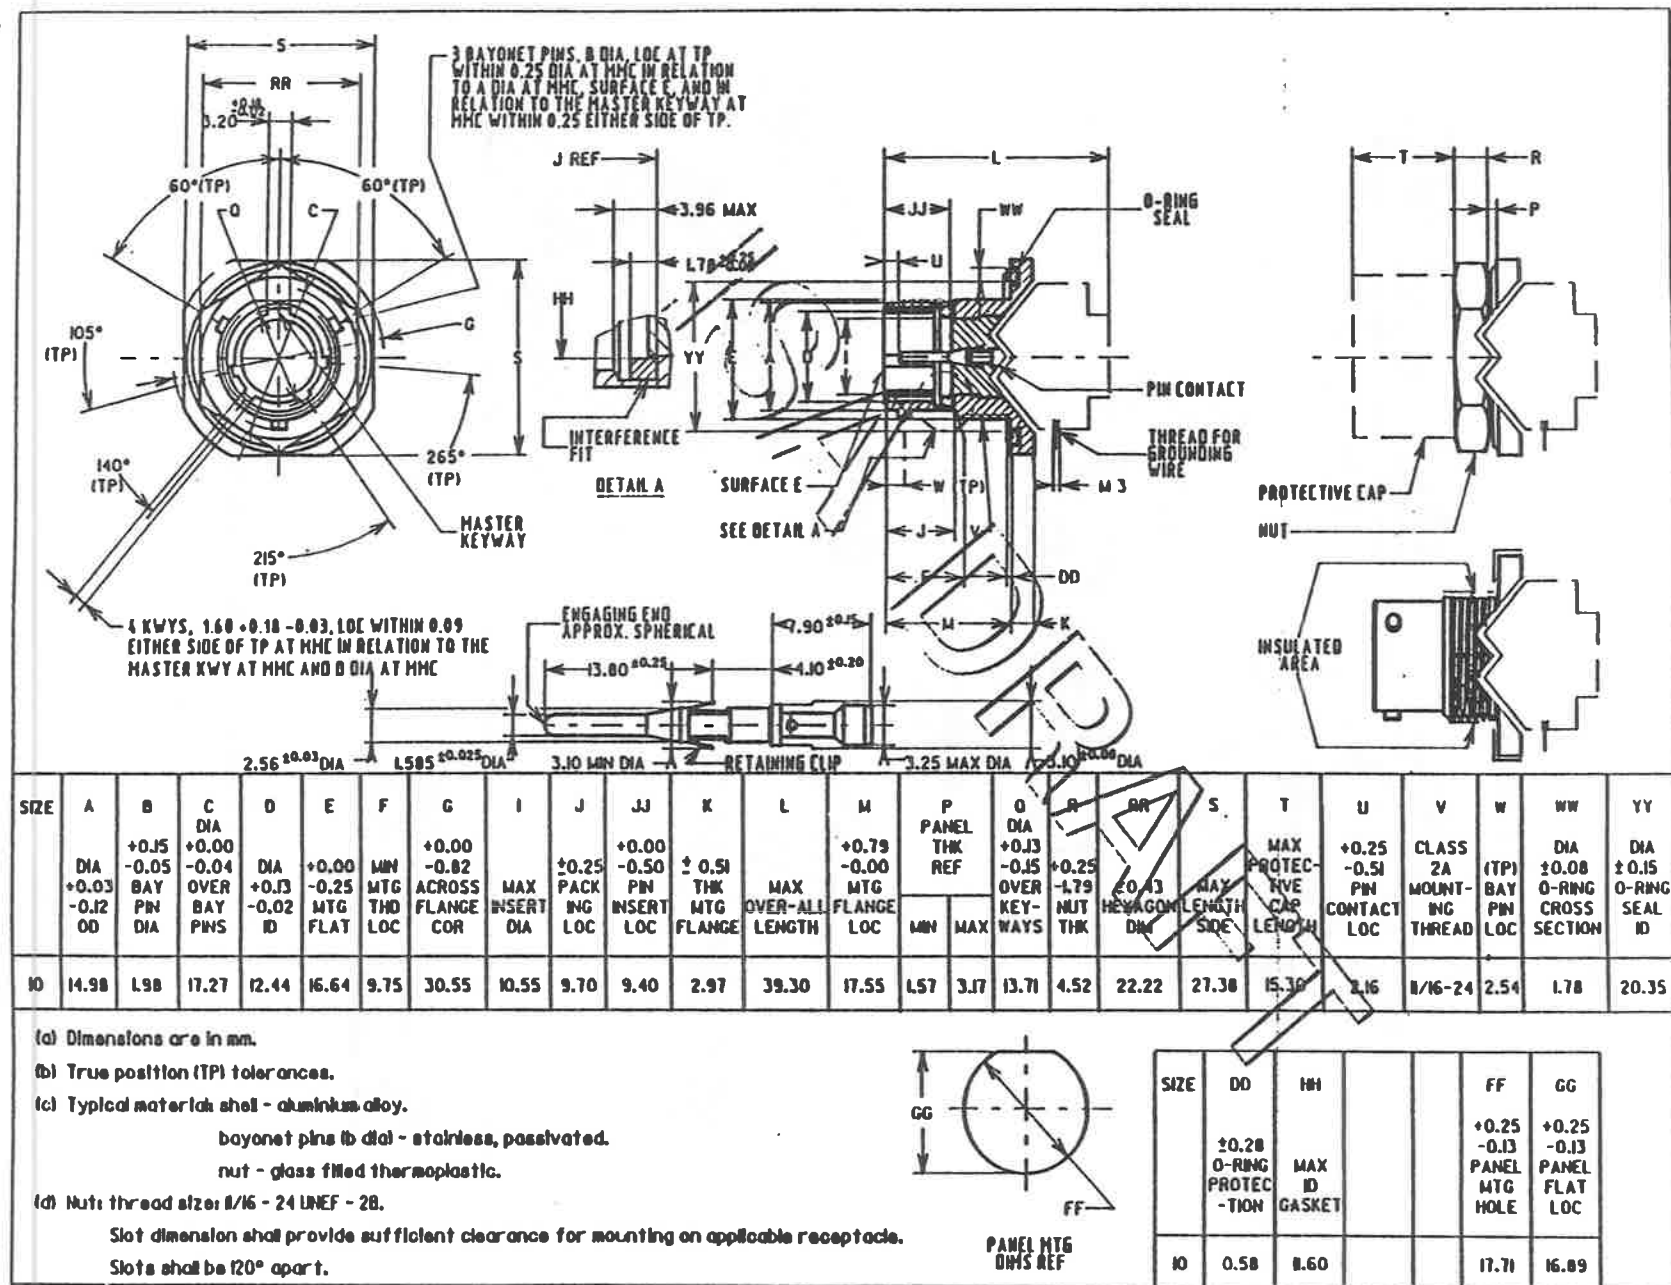

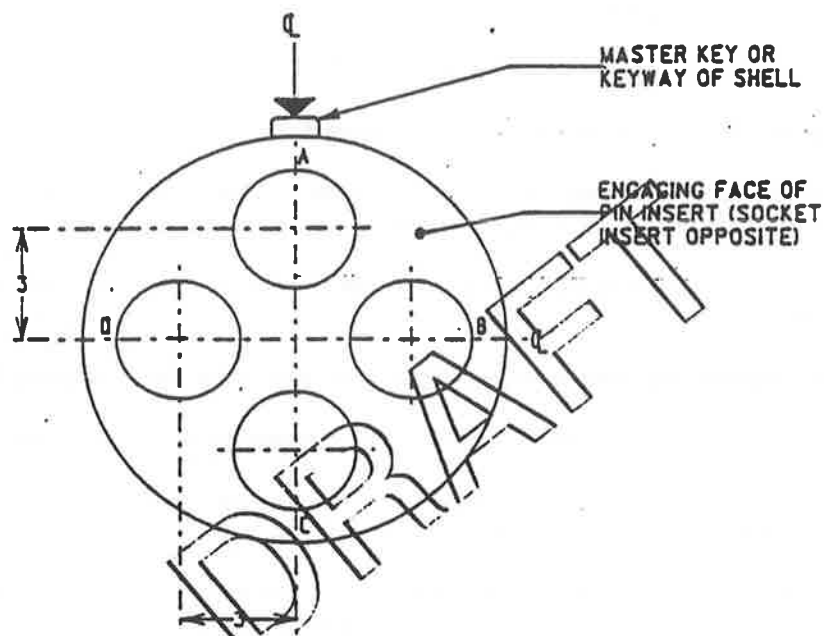

Shell size	Number of contacts	Size contacts
10	4	16

(a) Dimensions are in mm.

(b) Insert arrangement is shown in the 'normal position' in the shell with the A cavity in front of the master key or keyway of shell. Only this 'normal position' shall be used.

(c) Four keys or keyways (MMC) and insert shall be located within 0.09 either side of (TP) relative to master key or keyway (MMC) and shell OD or ID (MMC).

Figure B.5 — External Field Bus connector contact arrangement

B.2.2 External connector for typical industrial environments

A connector for typical industrial environments shall meet the following functional requirements:

- a) polarized to avoid conductors being interchanged, both mated and unmated;
- b) completely surrounded by a conductive shell;
- c) provided with male contacts on the fixed (device) side, and with female threaded stand-offs for screw type locking (4-40NC-2B thread);
- d) provided with female contacts on the free (cable) side, and with locking screws (4-40NC-2A thread);
- e) provided with nine pins (two signal pins, two power pins, and five reserved pins)
- f) contacts shall be assigned to functions as shown in figure B.6 and table B.3;
- g) connector dimensions (mating face) shall be as shown in figures B.7 and B.8, tables B.4 and B.5, and specified in IEC 807-3.

Table B.3 — Contact assignments for the external connector for typical industrial environments

Contact No.	Function
1	Reserved
2	Reserved
3	Reserved
4	Reserved
5	Reserved
6	Data+ with the option of power+
7	Data- with the option of power-
8	Reserved for option of power+
9	Reserved for option of power-

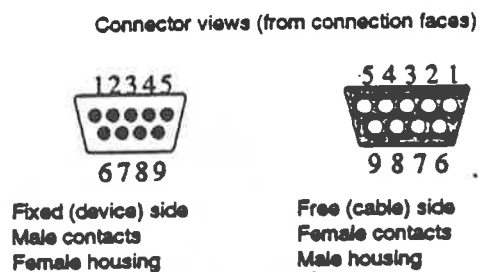


Figure B.6 — Contact designations for the external connector for typical industrial environments

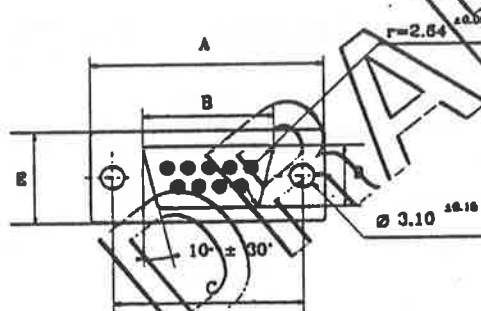


Figure B.7 — External fixed (device) side connector for typical industrial environments: dimensions

Table B.4 — Fixed (device) side connector dimensions

Fixed (device) side connector (male contacts, female housing)				
	millimetres		inches	
	max.	min.	max.	min.
A	31.19	30.43	1.23	1.20
B	17.04	16.79	0.67	0.66
C	25.12	24.87	0.99	0.98
D	8.48	8.23	0.33	0.32
E	12.93	12.17	0.51	0.48

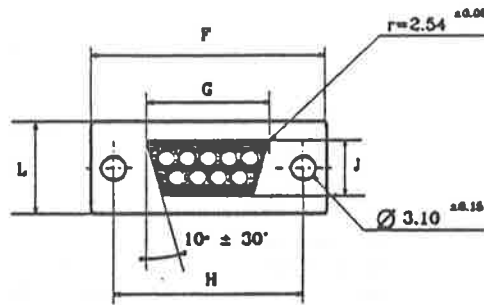


Figure B.8 — External free (cable) side connector for typical industrial environments: dimensions

Table B.5 — Free (cable) side connector dimensions

Free (cable) side connector. (female contacts, male housing)				
	millimetres		inches	
	max	min	max	min
F	31.19	30.43	1.23	1.20
G	16.46	16.21	0.65	0.64
H	25.12	24.87	0.99	0.98
J	8.03	7.77	0.32	0.31
L	12.93	12.17	0.51	0.48

ISA DRAFT

Developing and promulgating technically sound, consensus standards and recommended practices is one of ISA's primary goals. To achieve this goal the Standards and Practices Department relies on the technical expertise and efforts of volunteer committee members, chairmen and reviewers.

ISA is an American National Standards Institute (ANSI) accredited organization. ISA administers United States Technical Advisory Groups (USTAG's) and provides secretariat support for International Electrotechnical Commission (IEC) and International Organization for Standardization (ISO) committees that develop process measurement and control standards. To obtain additional information on the Society's standards program, please write:

Instrument Society of America
Attn: Standards Department
67 Alexander Drive
P.O. Box 12277
Research Triangle Park, NC 27709

ISBN 1-55617-200-1